


Feasibility Assessment of the Water Energy Resources of the United States for New Low Power and Small Hydro Classes of Hydroelectric Plants

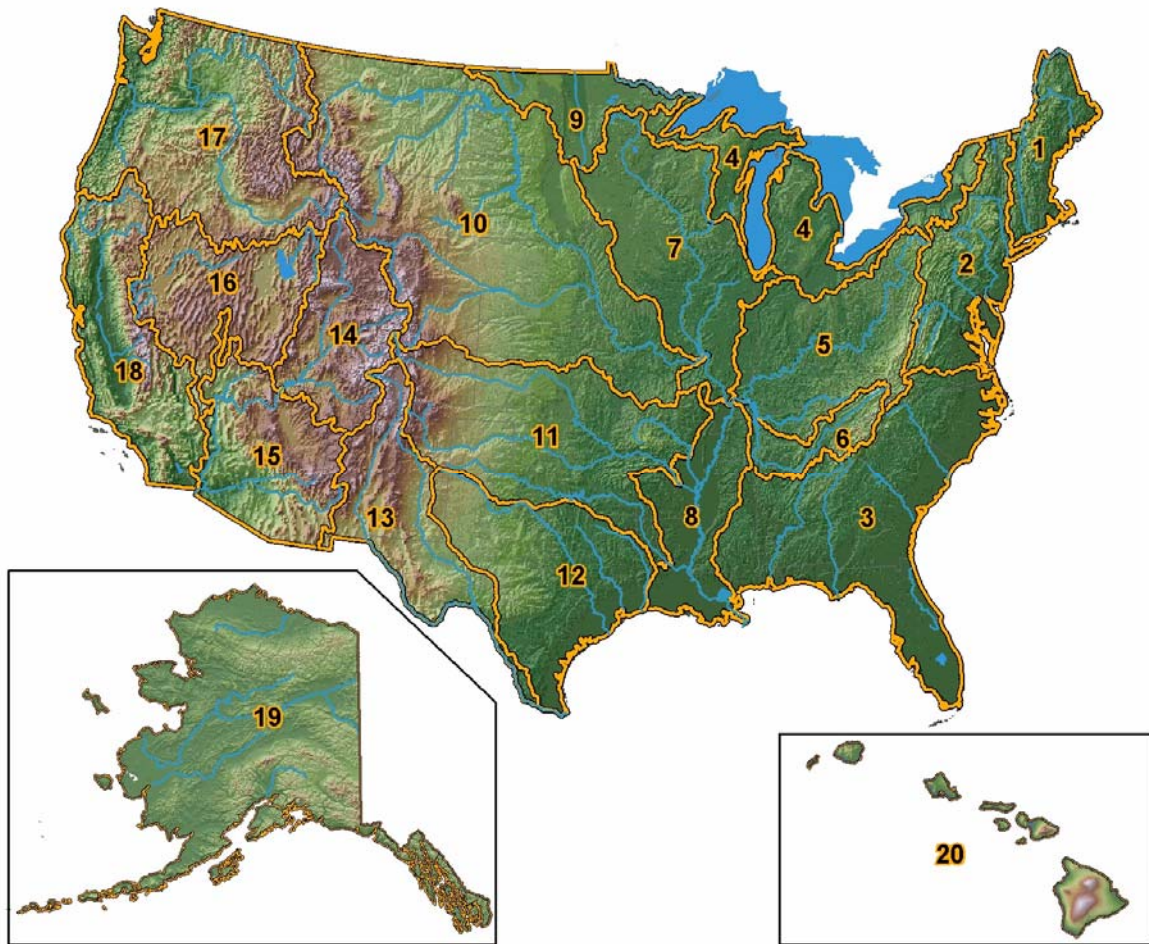

U.S. Department of Energy
Energy Efficiency and Renewable Energy
Wind and Hydropower Technologies

A Strong Energy Portfolio for a Strong America

Energy efficiency and clean, renewable energy will mean a stronger economy, a cleaner environment, and greater energy independence for America. By investing in technology breakthroughs today, our nation can look forward to a more resilient economy and secure future.

Far-reaching technology changes will be essential to America's energy future. Working with a wide array of state, community, industry, and university partners, the U.S. Department of Energy's Office of Energy Efficiency and Renewable Energy invests in a portfolio of energy technologies that will:

- Conserve energy in the residential, commercial, industrial, government, and transportation sectors
- Increase and diversify energy supply, with a focus on renewable domestic sources
- Upgrade our national energy infrastructure
- Facilitate the emergence of hydrogen technologies as a vital new "energy carrier."

To learn more, visit <http://www.eere.energy.gov/>

NOTICE

The information in this report is as accurate as possible within the limitations of the uncertainties of the basic data and methods used. The power potential quantities presented in the report were determined analytically. Document users need to ensure that the information in this report is adequate for their intended use. Battelle Energy Alliance, LLC makes no representation or warranty, expressed or implied, as to the completeness, accuracy, or usability of the data or information contained in this report.

The term "available" as used to refer to water energy resource sites or a category of power potential in this report denotes only that sites and their corresponding power potential are not located in a zone where hydropower development is unlikely and do not correspond to the location of an existing hydroelectric plant. The term does not denote any knowledge of the feasibility of developing or of any resource owner or agency having jurisdiction over a resource having an interest in developing or intent to develop any resource for the purpose of hydroelectric generation.

The term "feasible" as used to refer to water energy resource sites or a category of power potential in this report denotes only that sites and their corresponding power potential have met a limited set of feasibility criteria and been so designated via the methodology described in the report. Actual feasibility of a site for development as a hydroelectric plant must be determined by a site specific, comprehensive evaluation performed by the perspective developer.

DISCLAIMER

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

Feasibility Assessment of the Water Energy Resources of the United States for New Low Power and Small Hydro Classes of Hydroelectric Plants

**Douglas G. Hall, INL
Kelly S. Reeves, NPS
Julie Brizzee, INL
Randy D. Lee, INL
Gregory R. Carroll, BNI
Garold L. Sommers, INL, retired**

IDAHO NATIONAL LABORATORY

Published January 2006

**Prepared for the
U.S. Department of Energy
Office of Energy Efficiency and Renewable Energy
Wind and Hydropower Technologies Program
Idaho Operations Office**

ABSTRACT

Water energy resource sites identified in the resource assessment study reported in *Water Energy Resources of the United States with Emphasis on Low Head/Low Power Resources*, DOE/ID-11111, April 2004 were evaluated to identify which could feasibly be developed using a set of feasibility criteria. The gross power potential of the sites estimated in the previous study was refined to determine the realistic hydropower potential of the sites using a set of development criteria assuming they are developed as low power (less than 1 MWa) or small hydro (between 1 and 30 MWa) projects. The methodologies for performing the feasibility assessment and estimating hydropower potential are described. The results for the country in terms of the number of feasible sites, their total gross power potential, and their total hydropower potential are presented. The spatial distribution of the feasible potential projects is presented on maps of the conterminous U.S. and Alaska and Hawaii. Results summaries for each of the 50 states are presented in an appendix. The results of the study are also viewable using a Virtual Hydropower Prospector geographic information system application accessible on the Internet at: <http://hydropower.inl.gov/prospector>.

SUMMARY

The U.S. Department of Energy (DOE) has an ongoing interest in assessing the water energy resources of the United States. Previous assessments have focused on potential projects having a capacity of 1 MW and above. These assessments were also based on previously identified sites with a recognized, although varying, level of development potential.

The Idaho National Laboratory with the assistance of the U.S. Geological Survey completed water energy resource assessments of all 20 hydrologic regions in the United States in 2004 (reported in *Water Energy Resources of the United States with Emphasis on Low Head/Low Power Resources*, DOE/ID-11111, April 2004). In combination these results produced an assessment of the gross power potential of every natural stream in the United States. Parsing of the regional assessment results using geographic information system (GIS) tools produced assessment results for each of the 50 states.

In the present study, the water energy resource sites that were identified in the prior study were evaluated to determine the feasibility of their development using a set of feasibility criteria. These criteria considered site accessibility, load or transmission proximity, and land use or environmental sensitivities that would make development unlikely. Water energy resource sites that met the feasibility criteria were designated as feasible potential project sites. More realistic estimates of the power potential of these sites were determined by assuming a development model not requiring a dam obstructing the watercourse or the formation of a reservoir. The development model included a penstock running parallel to the stream, culminating in a powerhouse whose tailwater returned the working flow to the stream. It was assumed that only a low power (<1 MWa) or small hydro (≥ 1 MWa and ≤ 30 MWa) plant would be installed at the site. The working flow was restricted to half the stream flow rate at the site or sufficient flow to produce 30 MWa, whichever was less. Penstock lengths were limited by the lengths of penstocks of a majority of existing low power or small hydroelectric plants in the region. A methodology was employed to determine the optimum penstock length and location on the stream reach corresponding to the site based on yielding the maximum hydraulic head with the minimum length.

The population of water energy resource sites that was assessed was composed of slightly over 500,000 sites having a collective, gross power potential of slightly less than 300,000 MWa. The feasibility assessment identified approximately 130,000 sites meeting the feasibility criteria. These sites have a total gross power potential of nearly 100,000 MWa. Application of the development model with the associated limits on working flow and penstock length resulted in a total hydropower potential of 30,000 MWa. This amount of potential power is on the order of the total annual average power of the entire existing U.S. hydroelectric plant population. The approximately 5,400 sites that could potentially be developed as small hydro plants have a total hydropower potential of a little over 18,000 MWa. If developed, these projects would result in a greater than 50% increase in hydroelectric generation.

The regional results were parsed into results for the individual 50 states using GIS tools. Gross power potentials and hydropower potentials for feasible

potential projects are presented for each state. Six western states, Alaska, Washington, California, Idaho, Oregon, and Montana, have the highest power potentials. From the perspective of the density of hydropower potential (kW/sq mi) that could feasibly be developed, Hawaii and Washington have the highest densities of feasibly developable resources. By comparing hydropower potential associated with feasible projects to the total annual average power of the existing hydroelectric plants in the state, it was found that 33 states could increase their hydropower generation by 100% or more and 41 states could realize increases of more than 50%. A map showing the locations of the feasible potential project sites indicates that with the exceptions of part or most of eight states, potential projects are abundant throughout the country. Summaries of the gross and feasible potential in each state are provided in Appendix B.

It is concluded from the study results that there are a large number of opportunities for increasing U.S. hydroelectric generation throughout the country that are feasible based on an elementary set of feasibility criteria. These opportunities collectively represent a potential for approximately doubling U.S. hydroelectric generation (not including pumped storage), but more realistically offer the means to at least increase hydroelectric generation by more than 50%. Compared to current in-state hydroelectric generation, nearly all of the states are underutilizing their natural stream water energy resources and could realize significant gains in generation from new hydroelectric plant development. Western states, including Alaska and Hawaii, have particularly large feasible hydropower potentials or densities of feasible hydropower potential. The majority of the identified feasible hydropower potential could be harnessed without constructing new dams, using existing techniques and technologies developed over the long and extensive history of installing small hydroelectric plants in the U.S.

The results of the prior assessment of water energy resources and this feasibility study have been incorporated into a GIS application accessible on the Internet at: <http://hydropower.inl.gov/prospector>. The application named the Virtual Hydropower Prospector (VHP) displays sites on hydrologic region maps. In addition to the sites, the user can select what context features are displayed, including hydrography, the power system, transportation, areas and places, and land use. Tools to select features and display their attributes are provided along with standard map navigation tools. The application has a print capability so that any map the user creates can be printed or incorporated into a document or slide show. VHP extends and enhances this report by providing detailed information about water energy resource sites and feasible potential projects and providing sufficient information for users to conduct specialized, preliminary feasibility assessments.

The last section in the report provides recommendations for additional studies. These include: refining the feasibility assessment by considering additional factors affecting feasibility and true hydropower potential; upgrading VHP by displaying high resolution topography and additional context feature sets; using the data produced in the prior and present study to produce customized reports of resources on military bases and tribal lands; performing natural stream resource and feasibility studies for other countries; performing similar assessments for other water energy resources such as ocean, tidal, and

constructed waterways; and producing a catalog of technologies and cost estimating tools for small hydroelectric plants. These studies have the common objective of facilitating the planning and development of small hydroelectric plants with their attendant benefits using diverse technologies at locations around the globe.

For further information or comments, please contact:

Douglas G. Hall, Project Manager
Small Hydropower Resource Assessment and Technology Development Project
Idaho National Laboratory
P.O. Box 1625, MS 3830
Idaho Falls, ID 83415-3830
Phone: (208) 526-9525
E-mail: douglas.hall@inl.gov

ACKNOWLEDGMENTS

The authors acknowledge and express their appreciation for the contributions to this study made by the U.S. Geological Survey: Earth Resources Observation Systems Data Center for producing the Elevation Derivatives for National Applications (EDNA) datasets for the 20 hydrologic regions of the United States, including high resolution synthetic hydrography, and programming and data processing, using the EDNA data in conjunction with climatic data to produce the basic power potential datasets and elevation annotated synthetic hydrography with particular recognition of the contributions of Ms. K. L. Verdin and Mr. M. Cast. The authors acknowledge and express their appreciation of project team member Ms. S. E. White, who produced the Virtual Hydropower Prospector GIS application that extends access to and the utility of the study results presented in this report. The authors acknowledge and express their appreciation for the technical editing and word processing of this document by Ms. J. K. Wright and Ms. D. R. Southwick, respectively. The authors acknowledge and express their appreciation for the technical guidance provided by members of the project technical advisory committee who are too numerous to mention by name. Particular acknowledgment and appreciation of Ms. P. A. Brookshier of the U.S. Department of Energy Idaho Operations Office is expressed for requesting the resource assessment research culminating in this report.

CONTENTS

ABSTRACT	iii
SUMMARY	v
ACKNOWLEDGMENTS	ix
ACRONYMS	xv
NOMENCLATURE	xvii
1. INTRODUCTION	1
2. STUDY AREA—TWENTY HYDROLOGIC REGIONS OF THE UNITED STATES	4
2.1 Geographic Description	4
2.2 Existing Hydroelectric Plants	7
3. TECHNICAL APPROACH	8
3.1 Water Energy Resource Site Population	8
3.2 Site Hydropower Potential	9
3.2.1 Project Penstock Length	10
3.2.2 Project Working Flow Rate	13
3.2.3 Logic for Selecting Site Development Parameters	13
3.2.4 Summary of Site Development Criteria for Estimating Project Hydropower Potential	14
3.3 Project Feasibility Criteria	14
3.4 Identification of Feasible Potential Projects	17
4. RESULTS	19
4.1 Power Category Distribution of Assessed Water Energy Resource Site Population	19
4.2 Power and Technologies Class Distribution of Feasible Potential Projects	21
4.3 Spatial Distribution of Water Energy Resources and Potential Projects	24
4.4 Potential Project Location and Attributes Provided by the Virtual Hydropower Prospector	33
5. CONCLUSIONS	35
6. RECOMMENDATIONS	37
7. REFERENCES	39

Appendix A—Description of Exclusion Zones	A-1
Appendix B—Assessment Results by State	B-1

FIGURES

1. The 20 hydrologic regions (units) of the United States.....	5
2. Power class distribution of U.S. hydroelectric plants and their total average power.	7
3. Power class distributions of U.S. water energy resource sites by number and gross power potential.....	9
4. Penstock lengths of low power hydroelectric plants in the Pacific Northwest Region.	10
5. Number of low power hydroelectric plants in the Pacific Northwest Region by penstock length interval and cumulative percentage of plants having penstocks of a given length or shorter.....	11
6. Penstock lengths of small hydroelectric plants in the Pacific Northwest Region.	11
7. Number of small hydroelectric plants in the Pacific Northwest Region by penstock length interval and cumulative percentage of plants having penstocks of a given length or shorter.	11
8. Penstock length upper limits for low power and small hydro plants in 20 U.S. hydrologic regions.	12
9. Logic for determining whether a water energy resource site should be developed as a low power or small hydro project using development criteria thereby establishing working flow rate, penstock length, working hydraulic head, and hydropower potential.	15
10. a) Distribution of the distance of low power and small hydroelectric plants to a city or population center boundary. b) Cumulative distribution of the distance of low power and small hydroelectric plants to a city or population center boundary.....	17
11. Power category distribution of water energy resource sites having gross power potentials greater than or equal to 10 kWa and their associated total gross power potential.....	19
12. Operating envelopes of three classes of low power technologies.	21
13. Power category distribution of feasible potential projects and their associated total hydropower potential with low power projects further divided by low power technology classes.....	22
14. Distribution of (a) number and (b) group hydropower potential of U.S. low power potential projects.	23
15. Distribution of (a) number and (b) group hydropower potential of U.S. small hydro potential projects.	24

16.	Total gross power potential of water energy resources in the 50 states of the United States divided into feasible, other available, excluded, and developed power categories.	25
17.	Total gross power potential density of water energy resources in the 50 states of the United States divided into feasible, other available, excluded, and developed power categories.....	27
18.	Total hydropower potential of feasible low power and small hydro projects in the 50 states of the United States.	28
19.	Total hydropower potential density of feasible low power and small hydro projects in the 50 states of the United States.....	29
20.	Existing hydroelectric plants and feasible potential hydropower projects in the United States.	31
21.	Desktop of the Virtual Hydropower Prospect GIS application showing its areas for display and control.	34

TABLES

1.	Hydrologic regions of the United States.....	4
2.	Penstock upper limits for low power and small hydro plants by hydrologic region.	13
3.	Distances of 90% of low power and small hydro plants from cities and populated area boundaries in 20 hydrologic regions.	17
4.	GIS data layers used for proximity analyses.	18
5.	Water energy resource site attributes used in development feasibility assessment.....	18
6.	Power potential of U.S. water energy resource sites in power categories divided into power classes and low power technology classes.	22
7.	Comparison of hydropower potential of feasible potential projects with total annual average power of hydroelectric plants in each of the 50 states of the United States.....	26

ACRONYMS

BNI Bechtel National, Incorporated

DEM digital elevation model

DOE U.S. Department of Energy

EDNA Elevation Derivatives for National Applications

An analytically derived, three-dimensional dataset in which hydrologic features have been determined based on elevation data from the National Elevation Dataset, resulting in three-dimensional representations of “synthetic streams” (stream path coordinates plus corresponding elevations) and an associated catchment boundary for each synthetic reach (based on 1:24K-scale data for the conterminous United States and 1:63,360-scale data for Alaska) (*Note: EDNA synthetic stream reaches do not uniformly coincide with NHD reaches. Conflation of EDNA and NHD features to improve the quality of both datasets is a later phase EDNA development.*) (<http://edna.usgs.gov>)

EROS Earth Resources Observation Systems

FERC Federal Energy Regulatory Commission

GIS geographic information system

A set of digital geographic information, such as map layers and elevation data layers, which can be analyzed using both standardized data queries as well as spatial query techniques.

HPRA Hydroelectric Power Resources Assessment

HUC hydrologic unit code

INL Idaho National Laboratory

NHD National Hydrography Dataset

A comprehensive set of digital spatial data that contains information about surface water features such as lakes, ponds, streams, rivers, springs, and wells. (<http://nhd.usgs.gov>)

NPS Nuclear Placement Services


USGS U.S. Geological Survey

VHP Virtual Hydropower Prospector

NOMENCLATURE

Annual mean flow rate	The statistical mean of the flow rates occurring at a particular location during the course of 1 year. The annual mean flow rates were estimated using regional flow regression equations based on gauged stream flow rates that occurred over a period of many years. The annual mean flow rate in any given year will usually differ from the value predicted by the equations.
Annual mean power	<p>The statistical mean of the rate at which energy is produced over the course of 1 year. When based on the predicted annual mean flow rate and associated hydraulic head at a water energy resource site or based on working fractions of these quantities associated with a feasible potential project, the predicted annual mean power is the mean of the annual mean powers occurring over a period of many years. Such power values are denoted by units of “kW_a” or “MW_a”. The actual annual mean power in a specific year will usually differ from the predicted value.</p> <p>A power rating of a hydroelectric plant based on electricity generation at this rate throughout the course of a year would produce the average annual electricity generation of the plant; sometimes referred to as average megawatt power rating denoted in some usages by “MW_a.”</p>
Attribute	Characteristic information about a feature such as name or owner, or data describing it such as length or voltage.
Capacity	Typically refers to the design power rating of a hydroelectric plant and are denoted by units of “MW. Considering all U.S. hydroelectric plants, the average ratio of capacity to annual mean power is a factor of two.
Catchment	The local drainage area surrounding a stream reach that provides runoff to the reach as opposed to flow entering the reach at its upstream end resulting from runoff from upstream catchments.
Drainage area	The total surface area of the topography of a drainage basin.
Drainage basin	The geographic area supplying runoff to a particular point on a stream equal to the area of all the catchments associated with upstream stream reaches supplying flow to the point.
EDNA stream node	Starting point of an EDNA synthetic stream, a confluence on it or point of reference, or its terminus where it enters a saltwater body or a sink.
EDNA stream reach	That portion of an EDNA synthetic stream between two EDNA stream nodes. (Note: Each stream reach has an associated local catchment and an associated drainage basin.)
Exclusion zone	An area in which hydroelectric plant development is highly unlikely due to federal land use statutes or policies or environmental sensitivities.
Feasible potential project	A water energy resource site that has met a set of feasibility criteria, thus identifying it as feasible for development
Gross hydraulic head	The hydraulic head corresponding to the difference in the elevations at the upstream and downstream ends of a stream reach comprising a water energy resource site.

Gross power potential	Ideal hydroelectric power based on an annual mean flow rate and an associated gross hydraulic head having units of MWa (average megawatts) in this report. The actual value in any given year will usually differ from the predicted value because of annual variations in annual mean flow rate. (Note: In the case of the developed power potential of an actual hydroelectric plant, annual mean power [average power] of the plant is used as the developed power potential.)
Hydraulic head	The elevation difference between the upstream and downstream ends of a column of water (such as in a penstock).
Hydropower potential	The power potential of a feasible potential project based on its working flow rate and working hydraulic head having units of MWa (average megawatts) in this report.
Map server	An internet-based application that displays geographic information on a map.
Penstock	A pipe conducting water from the point of takeoff on a stream to a turbine.
Power category	The power category names used in this report to differentiate between categories of power potential are: “total,” “developed,” “excluded,” “available” and “feasible.” Total refers to all the power potential in a study area. Developed refers to the power potential corresponding to the sum of the annual mean power of all the existing hydroelectric plants in a study area. Excluded refers to the power potential existing within zones in a study area where hydropower development is highly unlikely based on federal law or policy or known environmental sensitivities. Available refers to power potential corresponding to water energy resource sites that are not located in zones where hydropower development is unlikely and are not collocated with an existing hydroelectric plant. (Note: Available does not denote availability based on ownership or control.) Feasible refers to power potential corresponding to water energy resource sites that have met the limited set of feasibility criteria used in this study. (Note: The actual feasibility of a specific site must be determined by a comprehensive evaluation performed by a perspective developer.)
Power class (water energy resource sites)	<p>The power and technology classes into which water energy resource sites have been divided based on their power potential and gross hydraulic head:</p> <ul style="list-style-type: none"> ● High Head/High Power ● Low Head/High Power ● High Head/Low Power ● Convention Turbine ● Unconventional Systems ● Microhydro <p>where high power refers to ≥ 1 MWA, low power refers to < 1 MWA, high head refers to ≥ 30 ft, and low head refers to < 30 ft. The conventional turbines, unconventional systems, and microhydro power technology classes are subclasses of the low power class defined by their operating envelopes as shown in the figure below.</p>

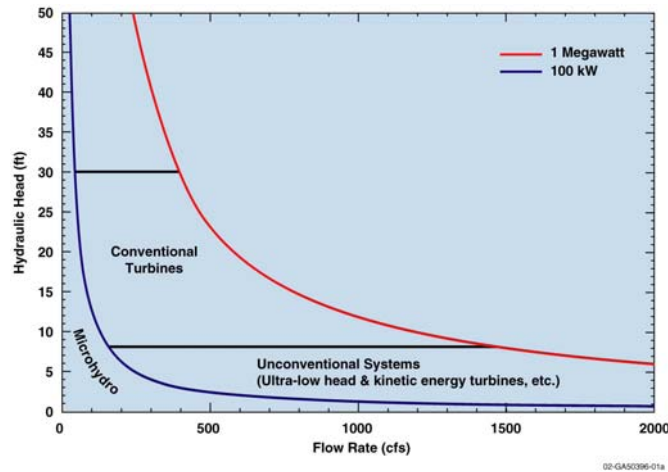

Power class
(feasible potential projects)

The power and technology classes into which feasible potential projects have been divided based on their hydropower potential and working hydraulic head:

- Small Hydro
- Low Head-Conventional Turbines
- Low Head-Unconventional Systems
- Microhydro

where small hydro refers to hydropower potential ≥ 1 MWA and ≤ 30 MWA, and low power refers to hydropower potential < 1 MWA. The conventional turbines, unconventional systems, and microhydro power technology classes are subclasses of the low power class defined by their operating envelopes as shown in the figure above except with no upper limit on hydraulic head for conventional turbines. When referring to the above figure for feasible potential projects, power (“1 Megawatt” or “100 kW”) is hydropower potential, “Flow Rate” is working flow rate, and “Hydraulic Head” is working hydraulic head.

Reach

A stream segment often delineated by two successive confluences.

Region

One of the 20 hydrologic regions into which the United States is divided, each composed of a set of drainage basins; in general, all flowing to the same stream or streams through which water flows out of the region. Regions are designated by hydrologic unit codes (HUC) from 1 through 20.

VHP desktop

The Virtual Hydropower Prospector (VHP) GIS application desktop displayed in a single window and composed of the map view and controls for selecting the graphical and numerical information displayed by the application. (Note: Multiple windows each containing a complete VHP desktop devoted to a different hydrologic region may be open at the same time.)

Water energy resource site

A stream reach for which the values of hydraulic head, annual mean flow rate, and power potential have been estimated. The site location is taken as the longitudinal midpoint of the reach.

Working flow rate

The rate of flow of water through a turbine.

Working head

The hydraulic head equal to the difference in the elevations of the entrance and exit of a penstock.

Feasibility Assessment of the Water Energy Resources of the United States for New Low Power and Small Hydro Classes of Hydroelectric Plants

1. INTRODUCTION

In June 1989, the U.S. Department of Energy (DOE) initiated the development of a National Energy Strategy to identify the energy resources available to support the expanding demand for energy in the United States. Past efforts to identify and measure the undeveloped hydropower capacity in the United States have resulted in estimates ranging from about 70,000 MW to almost 600,000 MW. The Federal Energy Regulatory Commission's (FERC's) capacity estimate was about 70,000 MW, and the U.S. Army Corps of Engineers' theoretical estimate was 580,000 MW. Public hearings conducted as part of the strategy development process indicated that the undeveloped hydropower resources were not well defined. One of the reasons was that no agency had previously estimated the undeveloped hydropower capacity based on site characteristics, stream flow data, and available hydraulic heads.

As a result, DOE established an interagency Hydropower Resources Assessment Team to ascertain the country's undeveloped hydropower potential. The team consisted of representatives from each power marketing administration (Alaska Power Administration, Bonneville Power Administration, Western Area Power Administration, Southwestern Power Administration, and Southeastern Power Administration), the Bureau of Reclamation, the Army Corps of Engineers, the FERC, the Idaho National Laboratory (INL), and the Oak Ridge National Laboratory. The interagency team drafted a preliminary assessment of potential hydropower resources in February 1990. This assessment estimated that 52,900 MW of undeveloped hydropower capacity existed in the United States.

Partial analysis of the hydropower resource database by groups in the hydropower industry indicated that the hydropower data included redundancies and errors that reduced confidence in

the published estimates of developable hydropower capacity. DOE has continued assessing hydropower resources to correct these deficiencies, improve estimates of developable hydropower, and determine future policy. An assessment of the opportunities for increased hydropower capacity in the United States identified 5,677 sites having a total capacity increase potential of about 70,000 MW (Connor et al. 1998). Consideration of environmental, legal, and institutional constraints resulted in an estimate of about 30,000 MW of viable opportunities to increase the United States hydropower capacity.

The previous resource assessment (Connor et al. 1998) was a site-based assessment, which evaluated the potential for obtaining increased hydropower capacity at previously identified sites. During the 2002 to 2004 timeframe, INL conducted regional assessments and then a national assessment of the power potential of all streams in the study area culminating in a report documenting the power potential of all United States natural streams (Hall et al. 2004). This comprehensive assessment conducted in conjunction with the U.S. Geological Survey (USGS) used state-of-the-art digital elevation models and geographic information system (GIS) tools to estimate the power potential of a mathematical analog of every stream segment in the country. Summing the estimated power potential of all stream segments provided an estimate of the total power potential of U.S. natural streams. The study only assessed water energy resources associated with natural water courses (constructed waterways, tides, waves, and ocean currents were not included).

While the gross power potential estimates in the 2004 report are useful, the greatest insight gained from the reported results is the relative magnitudes when power potentials are compared.

Comparison of the magnitudes of state and regional power potentials and potential power densities shows those areas of the country having the most abundant and concentrated water energy resources. The spatial distribution maps included in the report also provide a visual measure of the relative concentration of water energy resources in the country. Comparison of developed, excluded, and available power potentials to the total power potential provides relative measures of these quantities that can be compared between areas to see the trends of past policy and development decisions and opportunities for future development. Comparison of power potential in the various power classes shows the relative abundance of water energy resources having certain hydraulic head and power characteristics, which can be used to guide future technology development.

Having completed the comprehensive assessment of the United States natural stream resources, the project addressed the ultimate resource questions:

- Which of the identified water energy resource sites can feasibly be developed?
- How much power can realistically be generated at the sites that are feasible?
- Where are the feasible potential project sites located?

The study reported in this document generated information that answers these questions. Feasibility criteria including exclusion of development, site accessibility, and transmission and load proximity were used to identify which water energy resource sites are locations for feasible potential projects. Development criteria regarding working flow rate and realistic penstock lengths were used to determine estimates of the realistic power potential of the feasible potential projects. The low power or small hydro project model that was used assumed power production without total stream impoundment or the creation

of a reservoir.^a Since the project worked with georeferenced data from inception, the location of feasible potential projects was known once they were identified. While the report contains a distribution map showing the locations of feasible projects, this map is most valuable for detecting gross concentrations of projects. A companion GIS application called the Virtual Hydropower Prospector (VHP), which is available on the Internet (<http://hydropower.inl.gov/prospector>), was produced as a tool for locating water energy resource sites and feasible potential projects and performing customized, preliminary feasibility assessments.

As with the results in the predecessor report, the reader is cautioned about an important distinction that is made in the presentation of power results in this report. The assessment method that was used produced estimates of power potential as annual mean power. This parameter is not the same as hydropower capacity, which has been assessed in other assessment efforts. The difference lies in potential being based on estimates of annual mean flow rate or a working fraction thereof combined with gross or working hydraulic head to produce an estimate of annual mean power potential. In contrast, hydropower capacity is the design power capacity of a real or hypothetical hydroelectric plant. Plant design capacity is derived based on anticipated flow rates, which may not be natural stream flows, and may be determined by economic considerations, and other factors. Because the assessment results are power potential values rather than plant capacity values, total power potential values listed in this report will appear low when compared with the results of prior assessments, which are based on owners' selections of design capacity or an economic model that selects a design capacity. The values listed in this report are directly convertible to generation by multiplying them by the number of hours in a year without the need to apply a capacity factor.

a. The development plant model included entry of part of the stream flow into a penstock running parallel to the stream channel leading to a powerhouse downstream of which the water was returned to the stream. Entry to the penstock could be accomplished by water takeoff at a bend, obstructing a secondary channel to create a power channel, or the use of a submerged weir.

This report is organized by presenting a description of the study area, details of the methods that were employed to perform the assessment, results of the assessments considering the study area at large, general conclusions based on the study results, and recommendations for additional related research. Appendix A describes the exclusion zones used in the study. Appendix B, which is a major fraction of the volume, contains summaries of the study results for each of the 50 states.

2. STUDY AREA—TWENTY HYDROLOGIC REGIONS OF THE UNITED STATES

The United States is divided into 20 hydrologic regions designated by the USGS that are shown in Figure 1. The hydrologic regions have been numbered using a hydrologic unit code (HUC) of 1 through 20. For example, the North Atlantic Hydrologic Region has been assigned a hydrologic unit code of 1 and is sometimes referred to as “HUC 1.” Eighteen hydrologic regions, HUC 1 through HUC 18, have been assigned to the conterminous United States. The remaining two hydrologic regions, HUC 19 and HUC 20, are assigned to Alaska and Hawaii, respectively. An additional region assigned to Puerto Rico, HUC 21, was not evaluated during this study. The hydrologic regions are listed by region or HUC number in Table 1.

Table 1. Hydrologic regions of the United States.

Region (HUC) No.	Name
1	North Atlantic
2	Mid-Atlantic
3	South Atlantic-Gulf
4	Great Lakes
5	Ohio
6	Tennessee
7	Upper Mississippi
8	Lower Mississippi
9	Souris Red-Rainy
10	Missouri
11	Arkansas-White-Red
12	Texas Gulf
13	Rio Grande
14	Upper Colorado
15	Lower Colorado
16	Great Basin
17	Pacific Northwest
18	California
19	Alaska
20	Hawaii

2.1 Geographic Description

The conterminous United States from east to west consists of a coastal plain along the Atlantic, the Appalachian Mountains, a vast interior lowland, and the western Cordillera, which is a wide system of mountains and valleys extending to the Pacific Ocean. The Atlantic Coastal plain is narrow in the mid-Atlantic states, but gradually widens toward the south to form a broad coastal plain in the Carolinas and Georgia. Estuaries and bays form deep indentations in the coastal plain, especially Delaware Bay and Chesapeake Bay in Delaware, Maryland, and Virginia. Inland from the coastal plain, the Piedmont forms a gentle rolling upland that borders the eastern slope of the Appalachians. The Appalachian Mountains form a long southwest-northeast trending chain of mountains that extend from northern Alabama to New England. From New York southward, the Appalachians are composed of a long series of alternating ridges and valleys, created by folding and erosion of ancient rock layers. The mountains continue into New England, but the ridge and valley pattern is absent. Breaks in mountain ridges, known as “water gaps,” allow several major rivers to cross part or all of this mountain chain, for example, the Connecticut River in New England, the Hudson River in New York, the Delaware River in Pennsylvania, the Susquehanna River in New York, Pennsylvania, and Maryland, and the Potomac River in Virginia, West Virginia, and Maryland.

West of the Appalachians lies a vast interior lowland that covers nearly half of the conterminous United States. It includes the drainage of the Mississippi River and its two major tributaries, the Ohio and Missouri rivers. The Mississippi River is the principal feature of this lowland, forming a major north-south waterway into the heartland of the United States. The lowland includes a wide coastal plain bordering the Gulf of Mexico, with rolling hills, river valleys, and extensive prairies lying north of the coastal plain. Dense deciduous woodlands

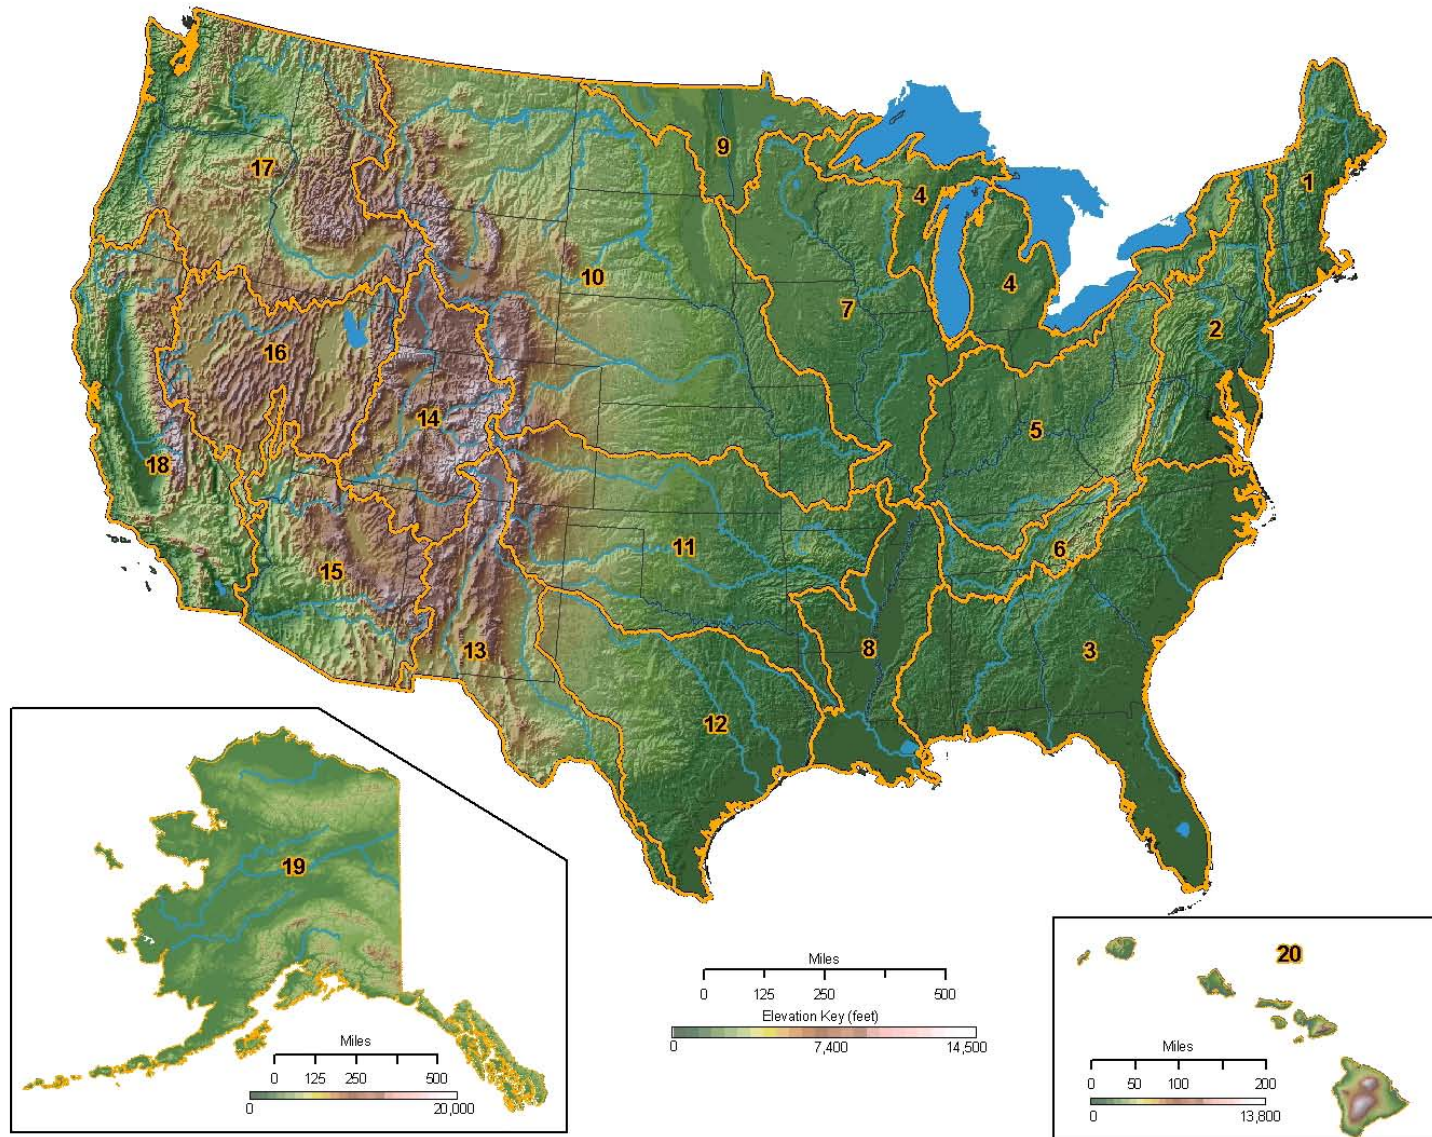


Figure 1. The 20 hydrologic regions (units) of the United States.

originally covered the eastern portion of the lowland, transitioning to pine forests in the south. Further west, the woodland gives way to prairie, a vast grassland mostly devoid of trees. Much of the woodland and prairie has been converted to agricultural use. The climate ranges from warm in the south to cold in the north, with precipitation decreasing toward the west.

A complex series of high mountain ranges, valleys, canyons, and plateaus create a spectacular landscape in the western United States. The Great Plains, which form the western portion of the interior lowlands, gradually rise thousands of feet in elevation to meet the abrupt eastern front of the Rocky Mountains. The Rocky Mountains are a chain of high mountain ranges extending from Mexico through the western United States into Canada. The crest of the Rocky Mountains forms the continental divide. Streams east of the continental divide flow to the Atlantic Ocean, the Gulf of Mexico, and the Hudson Bay. Most streams west of the continental divide flow to the Pacific Ocean or to the Gulf of California. However, streams in many areas west of the continental divide discharge into saline lakes or mud flats. These streams remain within the Great Basin, a series of semi-arid to arid mountains, valleys, and plains with no outlet to the sea. More high mountains are found in the West Coast states: the Cascades in Washington and Oregon and the Sierra Nevada in California. An additional set of mountain ranges, known as the Coast Ranges, borders the Pacific coastline of these three states.

The landscape varies greatly in the West. Cool, damp rainforests cover the slopes of the Coast Ranges in the Pacific Northwest. The Cascades and the Sierra Nevada have extensive coniferous forests due to abundant Pacific moisture. However, these ranges create a rain shadow that forms dry steppes and deserts immediately to their east. The two major rivers of the West, the Columbia River and the Colorado River, have been extensively developed for hydropower. The Grand Coulee Dam in Washington and the Hoover Dam on the Nevada-Arizona border are the best known of the West's hydropower mega-projects. Interior valleys have fertile soils suitable for farming, including the Great Central Valley of California, the

Willamette Valley of Oregon, and the Snake River Plain in Idaho. In many places, irrigation water from mountains or rivers is imported to water crops in arid areas. Water is also imported for hundreds of miles to supply the domestic needs of major coastal cities in California.

Alaska, the largest, northernmost, and least densely populated state, extends from temperate rainforests on the southeastern panhandle, to arctic tundra on the arid North Slope. High coastal and near-coastal mountain ranges receive abundant Pacific moisture as snow and ice to create the largest glaciated area outside of Antarctica and Greenland. Further inland, the Alaska Range reaches elevations exceeding 20,000 feet on Mt. McKinley, the highest point in North America. Approximately one-third of the state lies north of the Arctic Circle.

A large interior lowland, extending across the central portion of the state, is drained primarily by the Yukon River and its tributaries. Rivers and streams in this area are typically braided and are subject to intense season flooding due to rapid melting of snow and ice during the spring/summer thaw. The east-west trending Brooks Range lies north of this lowland. North of the Arctic Circle, the North Slope, a flat, arid plain slopes northward from the Brooks Range to the Arctic Ocean. Permafrost and tundra dominate the North Slope, home to the Arctic National Wildlife Refuge, as well as some of the United States' most productive oil fields.

Hawaii, a chain of eight volcanic islands, lies near the center of the Pacific Ocean, approximately 2,200 miles from the U.S. mainland. The island chain was formed by motion of the Pacific Plate over a stationary volcanic hot spot that extrudes molten rock to create a series of volcanic islands. The islands nearest to the hot spot, Hawaii and Maui, have active volcanoes and are the largest islands in the chain. Islands further from the hot spot no longer contain active volcanoes and are generally smaller due to subsidence and erosion. Islands with northern and eastern exposures to the Pacific receive abundant moisture up to several hundred inches per year. The opposite southern and western slopes lie in a rain shadow, where arid conditions predominate.

Some of the smaller islands are relatively dry because they lie entirely within the rain shadow of larger islands.

The Hawaiian Islands lack the large watersheds found on the U.S. mainland. Instead, streams on the islands generally run outward in a radial pattern from volcanic summits and mountain ridges toward the sea. The largest streams with the highest flow levels are found on the wetter northern and eastern slopes of the major islands.

2.2 Existing Hydroelectric Plants

The Hydroelectric Power Resources Assessment (HPRA) Database (FERC 1998) lists 2,378 hydroelectric plants in the United States (not including pumped storage plants). The distribution of these plants by power class is shown in Figure 2. The power classes are defined on the

basis of annual average power [$P_a = \text{Annual Generation}/\text{Annual Hours (8,760 hr)}$] rather than by design capacity. They include:

- Low power: $P_a < 1 \text{ MWa}$
- Small hydro: $1 \text{ MWa} \leq P_a \leq 30 \text{ MWa}$
- Large hydro: $P_a > 30 \text{ MWa}$.

The plant population produces energy at a total annual average rate of 35,432 MWa based on the average annual generation data in the HPRA Database. The 192 large hydro plants, which are only 8% of the plant population, produce 80% of the annual average power. On the other hand, 2,184 low power and small hydro plants constitute 92% of the plant population and produces the remaining 20% of the annual average power. Clearly, the public perception of hydroelectric plants is based on a small percentage of the plant population almost certainly without recognition that the vast majority of hydroelectric plants are small or very small plants.

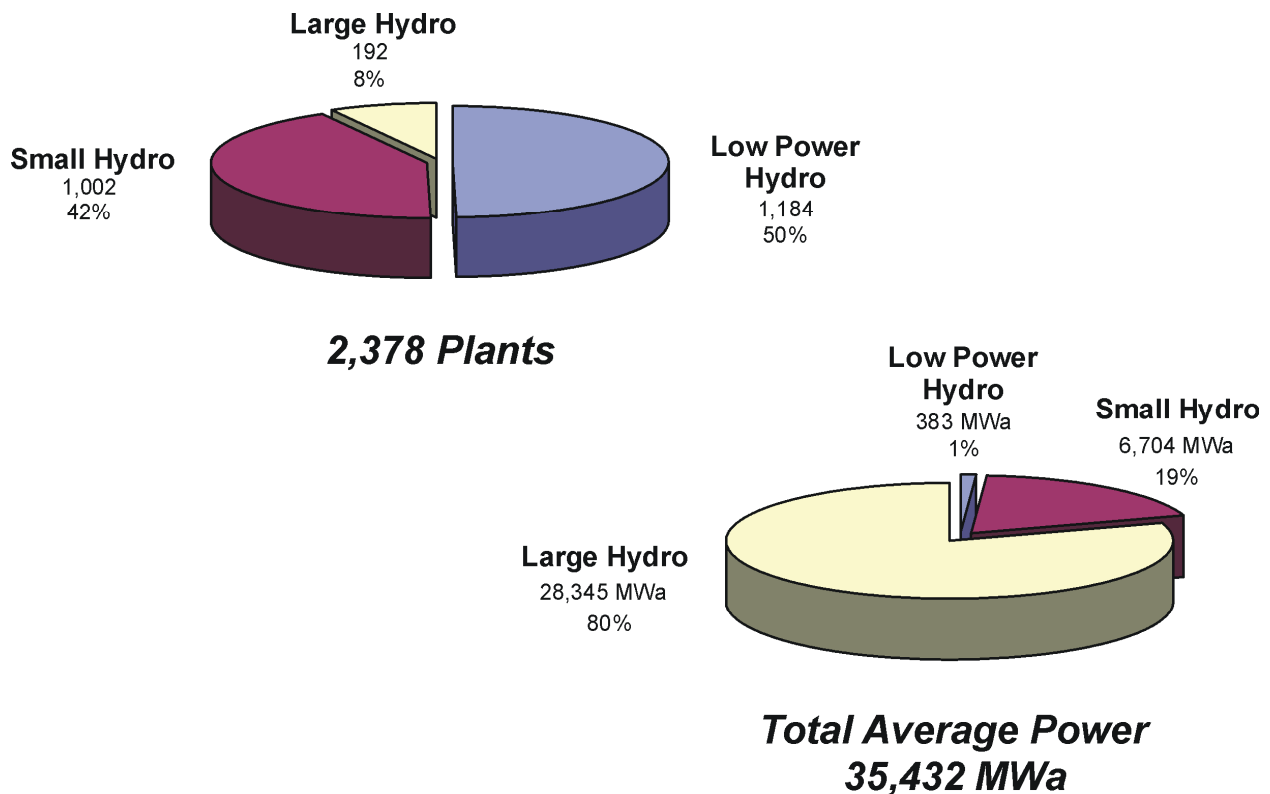


Figure 2. Power class distribution of U.S. hydroelectric plants and their total average power.

3. TECHNICAL APPROACH

Water energy resource sites in each of 20 hydrologic regions identified in the assessment of U.S. water energy resources (Hall et al. 2004) were assessed with regard to the feasibility of their development and the power potential of feasible sites considering development constraints. The feasibility assessment thus had two components:

- Selection of sites based on project feasibility criteria
- Estimation of power potential using realistic development criteria.

The technical approach as originally envisioned was first to identify sites that could feasibly be developed and then estimate the power potential of these sites using a development model with associated, realistic development constraints. During the evolution of the technical approach, it was determined that it would be necessary to first estimate the realistic power potential of all the sites and then determine the feasibility of their development. This approach was required because the assessment methodology that was finally employed required knowing the ultimate power class (low power or small hydro) of a potential project based on realistic development criteria as a prerequisite for applying one of the load/transmission proximity feasibility criteria.

The detailed description of the technical approach addresses:

- The population of U.S. water energy resource sites that were assessed
- Estimation of the power potential of these sites based on a development model with associated development constraints
- Identification of feasible potential projects based on a set of feasibility criteria.

Some of the feasibility and development criteria were selected based on engineering judgment. The rationale for each of these selections is provided in the discussion. Others were derived from characteristics of the existing hydroelectric plant population in each region.

The feasibility assessment was performed on a region by region basis. The results for the

20 hydrologic regions were combined to obtain nationwide results. Results for each of the 50 states were obtained by intersecting regional data with state boundaries. This was possible because of the water energy resource site data produced in the prior resource assessment and further attributed in the present study was georeferenced.

3.1 Water Energy Resource Site Population

The water energy resource sites that were assessed for development feasibility corresponded to all the validated stream reaches in the country having a gross power potential greater than 10 kWa. Validated stream reaches were segments of synthetic streams having an associated catchment area that contained a part of a stream in the National Hydrography Dataset (NHD). The validated reaches averaged 2 miles in length. The longitudinal midpoint of the reach was used as the geographic location of the water energy resource site.

The site population on which the feasibility assessment was performed numbered approximately 500,000 sites having gross power potentials greater than 10 kWa. The total number of sites countrywide was over one million. The distribution of water energy resource sites by the number of sites in each of three power classes (see Subsection 2.2 for power class definitions) and the corresponding, total, gross power potential of the sites is shown in Figure 3.

The site population assessed represented a total gross power potential of nearly 300,000 MWa. Figure 3 shows that over 99% of the feasibility assessed, water energy resource site population are low power and small hydro sites corresponding to 74% of the total gross power potential. There are a relatively small number of large hydro sites (874) that correspond to the remaining 26% of the total gross power potential if found to be feasible. The large hydro sites could be developed as low power or small hydro plants through partial use of the resource.

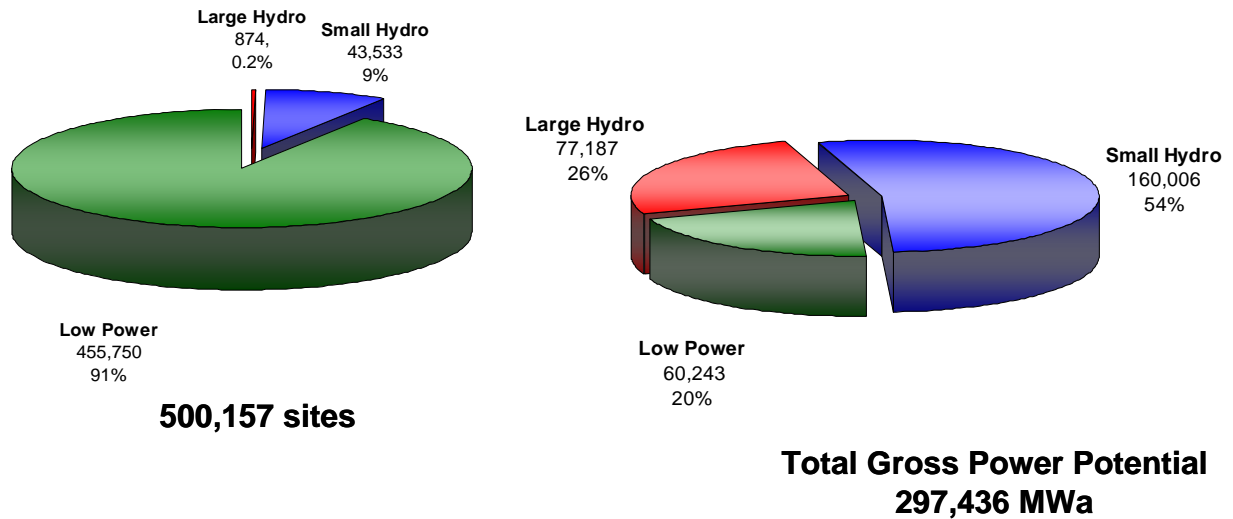


Figure 3. Power class distributions of U.S. water energy resource sites by number and gross power potential.

3.2 Site Hydropower Potential

The gross power potential of each water energy resource site was defined by the annual mean flow rate of the associated reach and gross hydraulic head equal to the elevation difference between the upstream and downstream ends of the reach. Use of the entire reach flow and installations of penstocks of 10,000 ft long on average, which was the average reach length, are not realistic for most low power and small hydro plants. It was, therefore, necessary to define a basic model for site development incorporating limitations on both the usable flow and the penstock length to estimate the true hydropower potential of the site.

The basic development model assumed was a hydroelectric plant producing power at an annual average rate of 30 MWa or less. The plant configuration did not include a dam obstructing the main stream channel and did not include water impoundment in its operation. The most simplistic version of the working model includes a water takeoff point on the stream bank at which water enters a penstock running parallel to the stream channel terminating at a powerhouse containing a single turbine-generator set. Downstream of the powerhouse, the water is returned to the stream channel. Induction of the water into the penstock may be by means of the takeoff point being at a

natural bend in the stream channel or use of a submerged diversion structure. It is also possible that a secondary branch of the stream is obstructed to produce a power channel from which water enters the penstock. Depending on the path of the stream channel, it is also possible that the penstock could run transverse to the stream channel terminating at a powerhouse located at a lower elevation beside the stream. However, this configuration was not considered in the feasibility assessments.

The realistic power potential of each water energy resource site was estimated by assigning limitations on working flow rate and penstock length within the context of the basic development model. A realistic optimum penstock length and location on the stream reach was determined for each site and followed by the determination of a working flow rate. The combination of working hydraulic head corresponding to the optimum penstock and the working flow rate provided the estimate of true hydropower potential power. The term “hydropower potential” is used to denote the power potential of a site with the development constraints applied as opposed to “gross potential,” which denotes a site’s power potential based solely on the associated stream reach flow rate and difference in the elevations at the upstream and downstream ends of the reach (gross hydraulic head). In either case, the power value is

annual mean power, which is directly convertible to annual generation, as opposed to the design capacity of the plant.

3.2.1 Project Penstock Length

The methodology for determining penstock lengths for water energy resource sites in a region involved several steps:

Step 1: Penstock lengths of existing low power and small hydro plants (FERC 1998) located in the region were reviewed to gain an understanding of realistic lengths.^b This review was used to establish upper limits for penstock lengths for low power and small hydro plants, respectively.

Step 2: The location on the stream reach where the maximum elevation difference was obtained using the upper limits of the low power, and small hydro penstock lengths or the reach length were established.

Step 3: Beginning with penstock lengths on the order of 30 m long, the optimal locations of penstocks of successive lengths up to the maximums were determined; each providing a corresponding hydraulic head.

Step 4: The optimum low power penstock and small hydro penstock lengths and their locations on the stream reach were identified as being those of the shortest length that captured 90% of the hydraulic head captured by using the respective upper limit penstocks optimally located on the reach. At this point in the hydropower potential estimation, it was not known whether the site was a low power or small hydro site based on its hydropower potential, because the working flow rate for the site had not been established.

The determination of optimal penstock locations and lengths required specialized, regional datasets from the Elevation Derivative for National Applications (EDNA), which was provided by the Earth Resources Observation System (EROS) Data Center. In these datasets, the elevation annotation of the synthetic stream reaches was expanded beyond having elevations

b. Plants having “Conduit Types” in the HPR Database of Canal, Concrete Flume, Pipeline and/or Conduit, and Other were not included.

only at the beginning and ending nodes of the reach. In these datasets, elevation data were available at every vertex along the reach. Because most of the synthetic hydrography was derived using 30-m digital elevation models, this meant that elevations were available every 30 or 42 m along the reach.

For the upper limit penstock lengths determined based on a regional plant population (Step 2 above), the optimal locations of penstocks of these lengths were determined by applying these lengths starting at successive nodes. The location yielding the maximum hydraulic head was the optimal location. When searching for the optimal penstock location and length (Steps 3 and 4 above), the location and corresponding hydraulic head of penstocks composed of every combination of contiguous nodes on the stream reach were evaluated up to the penstock length limits. The optimal low power and small hydro penstocks at a site were those combinations of location and minimum length that provided 90% of the hydraulic head obtained by optimal placement of penstocks having the low power and small hydro upper limit lengths.

The Pacific Northwest Region (HUC 17) is used to illustrate how upper limit low power and small hydro penstock lengths were determined. Penstock lengths for low power plants in the region are shown in Figure 4. The figure shows there are a large number of plants having penstock lengths less than 5,000 ft with the remainder having penstock lengths, ranging from 5,000 to 21,000 ft. The plants with the longer penstocks are most likely conduit installations associated with

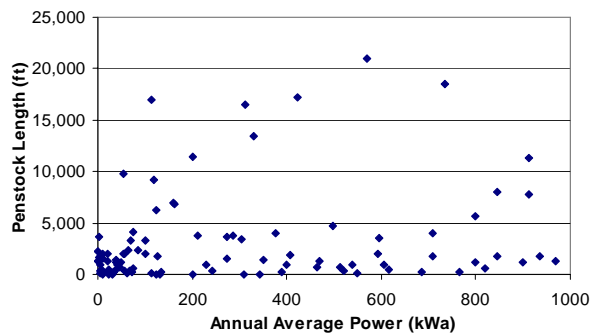


Figure 4. Penstock lengths of low power hydroelectric plants in the Pacific Northwest Region.

water delivery systems and are not typical for the natural stream installations, which are the subject of this study. It is also noteworthy that there is no correlation of penstock length with plant annual average power.

The number of plants having penstocks in 1,000-ft intervals ranging from 1,000 to 22,000 ft is shown in Figure 5. The figure also includes the cumulative percentage of plants having penstocks of a given length or less. There is a rapid rise in the percentage of the sample plant population as penstock length increases up to a penstock length of 4,000 ft. Eighty percent of the low power plants have penstocks of this length or less. For this reason, the upper limit of penstocks for potential low power projects in Region 17 was chosen to be 4,000 ft.

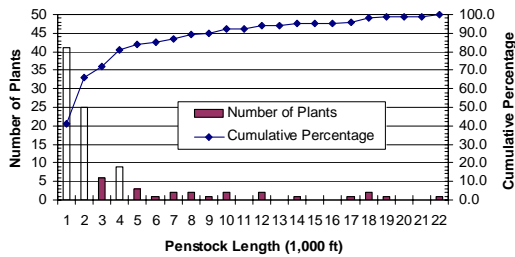


Figure 5. Number of low power hydroelectric plants in the Pacific Northwest Region by penstock length interval and cumulative percentage of plants having penstocks of a given length or shorter.

Penstock lengths for a sample of small hydropower plants in the region varied similarly to those for low power plants as shown in Figure 6. Most of the plants in this power class had penstocks less than 10,000 ft long with the remainder having penstock lengths ranging from 10,000 to 28,000 ft.

The number of plants having penstocks in 1,000-ft intervals ranging from 1,000 to 22,000 ft is shown in Figure 7 along with the cumulative percentage of plants having penstocks of a given length or less. Significant increases in the cumulative percentage of plants having penstocks of a given length or less occur up to a penstock length of 8,000 ft. Nearly 95% of the small hydro plants have penstocks of this length or less. For this reason, the upper limit of penstocks for potential small hydro projects in Region 17 was chosen to be 8,000 ft.

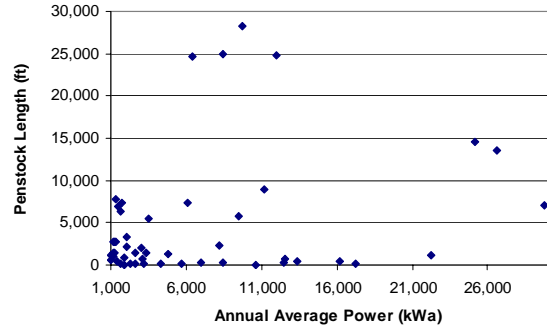


Figure 6. Penstock lengths of small hydroelectric plants in the Pacific Northwest Region.

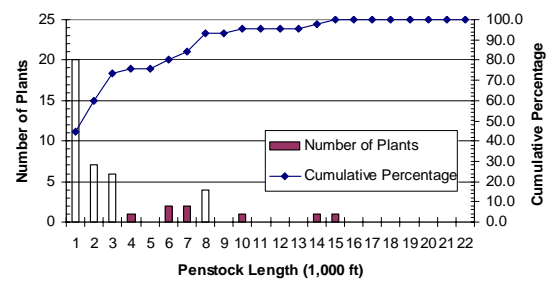


Figure 7. Number of small hydroelectric plants in the Pacific Northwest Region by penstock length interval and cumulative percentage of plants having penstocks of a given length or shorter.

Similar evaluations of the penstock lengths of low power and small hydro plants were carried out for each of the regions for which data were available. Upper limit penstock lengths for regions for which data were not available were determined based on values in neighboring regions considering topography, climate, and hydrology similarities and differences. Figure 8 shows the upper limit penstock lengths by region that are also given in Table 2 along with the rationale for assumed values.

The choice of whether the low power or small hydro penstock applied to the site was determined by the logic described in Subsection 3.3. This choice was dependent on the applicable working flow rate.

An interesting feature of the data shown in Figure 8 and presented in Table 2 is that while the penstocks of most of the low power plants are shorter than those of small hydro plants for regions on the East and West coasts, the relationship is

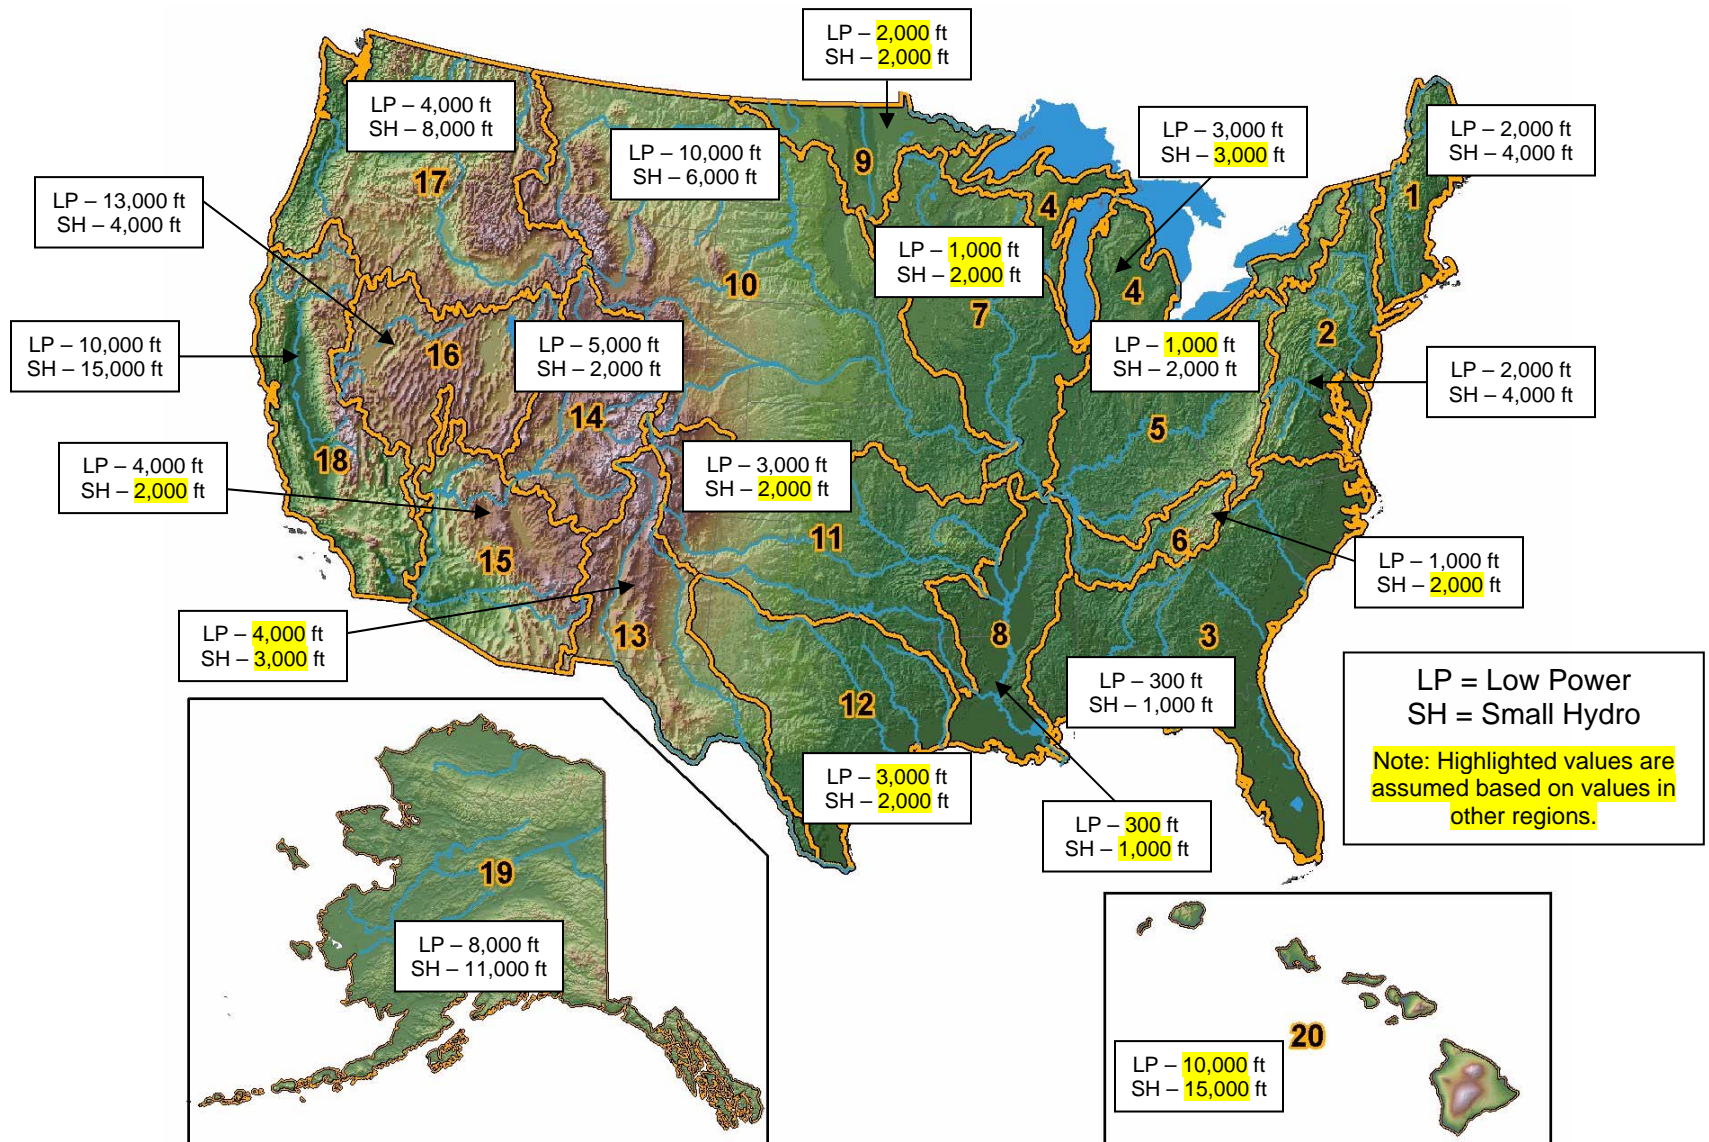


Figure 8. Penstock length upper limits for low power and small hydro plants in 20 U.S. hydrologic regions.

Table 2. Penstock upper limits for low power and small hydro plants by hydrologic region.

Region	Low Power		Small Hydro		Assumption Rationale
	No. of Plants	Penstock Length Upper Limit	No. of Plants	Penstock Length Upper Limit	
1	111	2,000	27	4,000	
2	44	2,000	37	4,000	
3	15	300	9	1,000	
4	28	3,000	37	3,000	
5	0	1,000	6	2,000	LP based on HUC 6 - similar topography, climate, and hydrology
6	4	1,000	0	2,000	SH based on HUC 5 - similar topography, climate, and hydrology
7	0	1,000	0	2,000	LP & SH based on HUCs 1-4 considering hydrology differences
8	0	300	0	1,000	LP & SH based on HUC 3 - similar topography, climate, and hydrology
9	0	2,000	0	2,000	LP & SH based on HUC 4 - considering hydrology differences
10	17	10,000	7	6,000	
11	4	3,000	0	2,000	SH based on HUC 10 using LP proportionality
12	0	3,000	0	2,000	LP & SH based on HUC 11 - similar topography, climate, and hydrology
13	0	4,000	0	3,000	LP & SH based on HUC 15 - similar topography and climate with hydrology differences
14	11	5,000	6	2,000	
15	4	4,000	0	2,000	SH based on HUC 14 - similar topography, climate, and hydrology
16	32	13,000	13	4,000	
17	100	4,000	49	8,000	
18	93	10,000	57	15,000	
19	8	8,000	11	11,000	
20	0	10,000	0	15,000	LP & SH based on HUC 18 - similar topography and stream flows
Total	471		259		

Note: Values highlighted in yellow indicate assumed values based on values in another region or regions selected using the rationale stated.

reversed for mid-West and Southwest regions. The former situation follows intuitive understanding that the higher power small hydro plants would require higher hydraulic heads and, therefore, longer penstocks. The reverse situation may be the result of insufficient data. It could also be the result of low power plants being sited on streams with relatively small flow rates, thus requiring long penstocks to obtain sufficient hydraulic head. Conversely, the small hydro plants in these regions tend to be located on the larger streams; therefore, being capable of producing more power without the need for long penstocks.

3.2.2 Project Working Flow Rate

Limitations were placed on working flow rates to estimate the hydropower potential of sites. The working flow rate was limited to the lesser of:

- Half the annual mean flow rate of the stream reach associated with the site
- The flow rate required to produce an annual average power of 30 MWA using the hydraulic head corresponding to the optimal small hydro penstock length and location.

In most cases, if the working flow rate was less than half the reach flow rate, it was because half the reach flow rate in combination with the hydraulic head corresponding to the optimal small hydro penstock for the site resulted in a hydropower potential greater than 30 MWA. Because this development of the site would no longer produce a small hydro plant, the flow rate was restricted so that the project hydropower potential would be 30 MWA. However, there were instances in Regions 10 through 16 where the working flow rate was reduced to less than half the reach flow rate even for low power projects as will be discussed in the next subsection.

3.2.3 Logic for Selecting Site Development Parameters

A logic scheme was used to determine whether a site would be developed as a low power or small hydro project. Optimal low power and small hydro penstock lengths and locations were determined as described in Subsection 3.2.1. Working flow limitations were adopted as described in the previous subsection. This information was combined to determine the power class of the project and associated development

parameters. The logic for this process is shown in Figure 9. The basic approach was first to try and develop the site as a small hydro project using half the reach flow rate and the optimal small hydro penstock for the site. This either resulted in reduction of the working flow rate to limit the project to being a small hydropower project, confirmation that the project could be developed as a small hydro project, or determination that there was not sufficient hydropower potential at the site, indicating a low power project development. If a low power project development was indicated, the only remaining step was to resolve an ambiguity that occurred in Regions 10 through 16. In these regions, it was possible for the optimum low power penstock for a site to be longer and, therefore, have more corresponding hydraulic head than the optimum small hydro penstock. It was thus possible to have the working flow rate equal to half the reach flow rate in combination with the small hydro penstock indicate a low power project and yet the working flow rate in combination with the low power penstock indicate a small hydro project. This ambiguity was resolved by arbitrarily reducing the working flow rate in combination with the optimum low power penstock and corresponding hydraulic head such that hydropower potential of the project was slightly less than 1 MWA, ensuring that it was a low power project. This approach was taken as opposed to reducing the low power penstock length to take the most conservative approach with regard to use of the stream resource.

3.2.4 Summary of Site Development Criteria for Estimating Project Hydropower Potential

The site development criteria that were used to estimate project hydropower potential were:

- Project location—optimal based on hydraulic head capture
- Penstock length
 - Low power project—optimal based on capturing 90% of hydraulic head captured with longest, typical penstock length based on existing low power plants in the region
 - Small hydro project—optimal based on capturing 90% of hydraulic head captured

with longest, typical penstock length based on existing small hydro plants in the region.

- Flow rate—lesser of:
 - Half the stream reach flow rate
 - Flow rate required to produce an annual average power of 30 MWa using hydraulic head corresponding to optimal small hydro penstock.

These assumptions are conservative for some sites for one or a combination of reasons. It was assumed that the penstock paralleled the stream for all projects. Depending on the topography and the stream path, it may be possible to capture more of the reach hydraulic head if the penstock is run transverse rather than parallel to the stream if it has a serpentine path. There may be instances in which more of stream flow can be used for power production than dictated by the development criteria. Flow rates have also been limited to that required to produce 30 MWa because of the focus of this study. Larger working flows and subsequently larger hydropower potentials exist at some sites and may be available for development. Finally, the hydropower model that has been used in this study is a potential energy conversion model. If a kinetic energy model consisting of one or a group of kinetic turbines had been applied to stream reaches having little power potential by virtue of little hydraulic head, but having adequate stream velocities, significant additional hydropower potential may well have been identified.

3.3 Project Feasibility Criteria

The project feasibility criteria that were used to identify feasible potential project sites addressed the likelihood of development based on land use and environmental sensitivities, prior development, site access, and load and transmission proximity. Specifically, the feasibility criteria applied to each water energy resource site were:

- Hydropower potential ≥ 10 kWa
- Does not lie within a zone in which development is excluded by federal law or policy

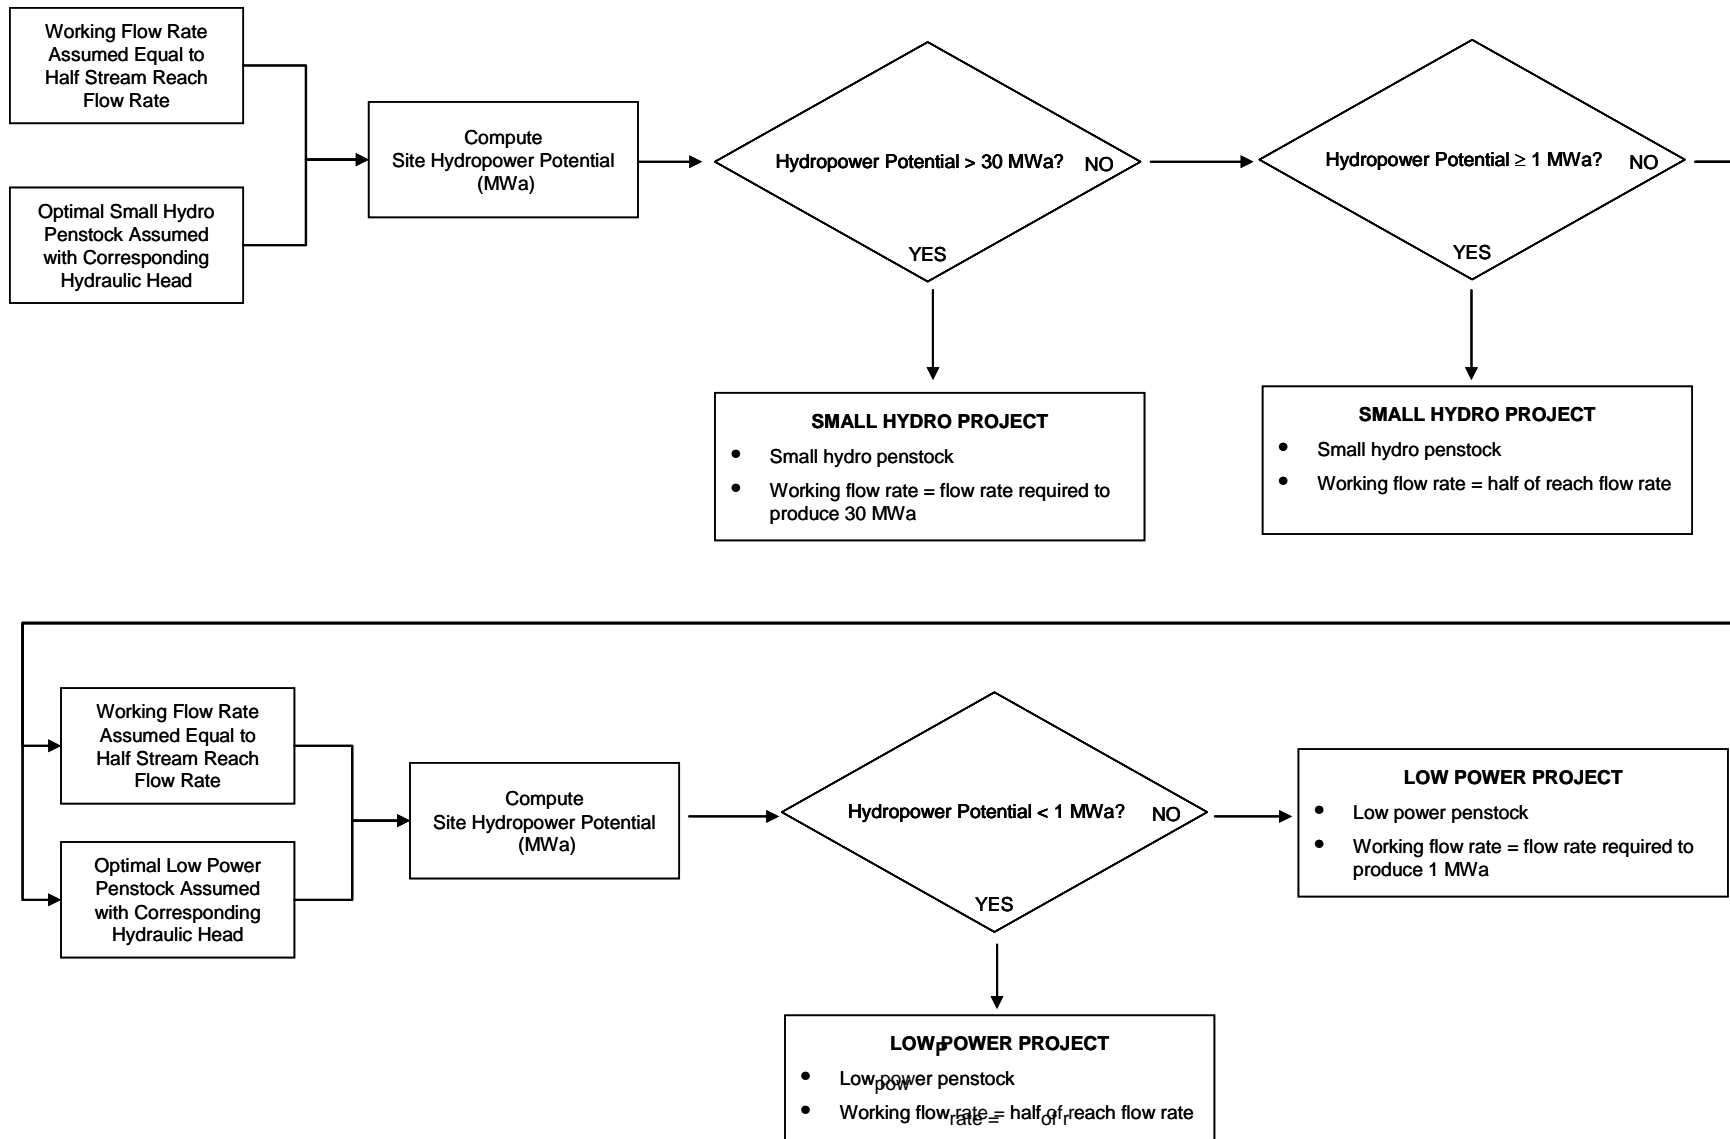


Figure 9. Logic for determining whether a water energy resource site should be developed as a low power or small hydro project using development criteria thereby establishing working flow rate, penstock length, working hydraulic head, and hydropower potential.

- Does not lie within a zone that makes development highly unlikely because of land use designations
- Does not coincide with an existing hydroelectric plant
- Is within 1 mile of a road
- Is within 1 mile of part of the power infrastructure (power plant, power line, or substation) **OR** is within a typical distance from a populated area for plants of the same power class in the region.

The question of whether site development was highly unlikely due to federal land use designation or environmental sensitivities was answered by intersecting the stream reaches corresponding to water energy resource sites with the polygons corresponding to the exclusion zones using GIS tools. (Descriptions of the exclusion zones used in this study are provided in Appendix A.) If any point on the reach fell within the exclusion zone, site development was considered to be unfeasible. On the other hand, a site could be very close to the exclusion zone boundary and not be disqualified based on the exclusion criterion (all parts of stream reach outside the boundary).

Sites that have already been developed into a hydroelectric plant were identified using a 2-mile search radius from the plant location to identify the water energy resource site that most nearly matched the head and annual average power of the plant. A search radius of this size was required, because it was found that some plant locations based on their geographic coordinates differed by this much and sometimes more from their obvious location at the head of a reservoir. Only hydroelectric plant locations were used, so it is possible that an existing dam without a power house is located at the feasible project site. Hydroelectric plant locations were provided by a combination of locations in the HPRA Database (FERC 1998), locations in ENERmap's power system data layer (ENERmap 2005), and manual corrections by matching plant locations to water features using GIS tools.

The accessibility criterion of the site being within 1 mile of a road was chosen because it was reasoned that particularly a low power hydroelectric project could not afford construction

of a road longer than 1 mile and be economically viable. This criterion was not found to be very restrictive, because proximity analysis revealed that 84% of the available resource sites were within 1 mile of a road. The ESRI Streetmap (ESRI 2004) GIS layer of roads was used in the proximity analysis.

The feasibility criterion for proximity to a part of the power infrastructure was also chosen to be 1 mile considering low power project funding constraints to construct a powerline to connect to existing power infrastructure. The feasibility analysis did not account for the voltage of the nearby powerlines or consider the affordability of the transformer required to connect the potential project to the grid. The power infrastructure was geographically represented by geospatial data provided by ENERmap, LLC (ENERmap 2005).

The feasibility criterion for proximity to cities and population centers was based on the distance of most of the existing hydroelectric plants in each power class (low power or small hydro) to a city or population center. Two GIS layers were required for this part of the proximity analysis. It was found that very small towns were best represented by a discrete city location. Larger populated areas were best represented by polygons corresponding to the boundary of the populated area. The feasibility criterion in this case was based on actual locations of hydroelectric plants rather than an assumed economic limitation as with the construction of an access road or hook up to a transmission line. It was reasoned that municipalities have local electrical lines extending beyond their boundaries that have made low power and small hydropower projects viable at some distance from the densely populated area. These lower voltage electrical lines were generally not represented in the electrical transmission GIS layer used in the analysis.

The distribution of low power and small hydroelectric plants to populated areas in the Pacific Northwest Region shown in Figure 10 is typical of most of the regions. The distributions for low power and small hydroelectric plants considered separately were sufficiently similar to the combined distribution shown in Figure 10 making it unnecessary to define separate criteria

for each power class. For this region, the distributions show that 90% of the low power and small hydro plants were within 10 miles of a city center or population center boundary.

The distances that 90% of the low power and small hydro plants are from a city or populated area boundary are shown in Table 3 for each of the 20 hydrologic regions. Application of the criterion for proximity to a city or populated area required knowing whether a water energy resource site would be developed as a low power or small hydro plant so that the correct proximity criterion could be used. It is for this reason that the hydropower potential and thus power class of each water energy resource site, if it was developed, was evaluated as described in Subsection 3.2 prior to the feasibility evaluation using the criteria described in this subsection.


3.4 Identification of Feasible Potential Projects

Evaluation of the water energy resource sites using the feasibility criteria described in the previous subsection required the water energy resource sites to be attributed with proximity data for each of the parameters addressed in the feasibility criteria. Proximity analyses were performed using GIS tools and the GIS data layers listed in Table 4. The results of the hydropower


potential assessment and the proximity analyses were entered into an Access database containing the attribute data for all water energy resource sites. The attributes used in the feasibility assessment are listed in Table 5.^c Queries on the database implementing the feasibility criteria resulted in identification of water energy resource sites that are the sites of feasible potential projects.

Table 3. Distances of 90% of low power and small hydro plants from cities and populated area boundaries in 20 hydrologic regions.

Region	Low Power Plant Distance in Miles	Small Hydro Plant Distance in Miles
1	4	4
2	5	5
3	5	5
4	4	7
5	2	6
6	5	5
7	4	4
8	4	4
9	1	1
10	7	7
11	7	4
12	3	8
13	4	4
14	7	7
15	5	10
16	6	4
17	10	10
18	8	8
19	10	10
20	2	2

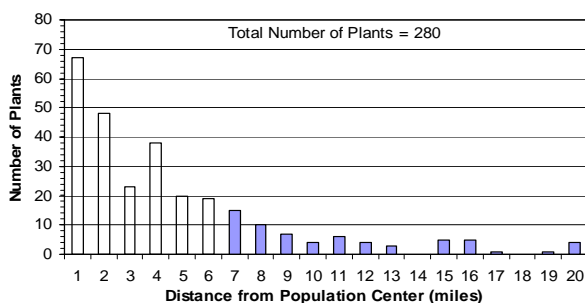

(a)

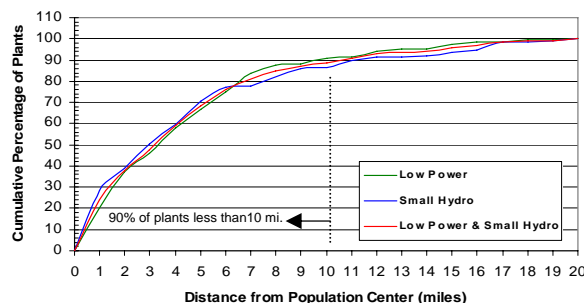

(b)

Figure 10. a) Distribution of the distance of low power and small hydroelectric plants to a city or population center boundary. b) Cumulative distribution of the distance of low power and small hydroelectric plants to a city or population center boundary.

c. The attributes listed in Table 5 are only those that were required to perform the feasibility assessment to identify feasible potential projects.

Table 4. GIS data layers used for proximity analyses.

Feature	Source	Data Vintage	Source Website
Federal Exclusion Zones	National Atlas of the United States Federal & Indian Lands Parkways & Scenic Rivers	2002	http://nationalatlas.gov/natlas/Natlass tart.asp
Environmental Exclusion Zones	Conservation Biology Institute	2005	http://www.consbio.org/
Roads	Environmental Systems Research Institute (ESRI) (Streetmap)	2004	http://www.esri.com/data/index.html
Power Infrastructure	Global Energy Decisions	2004	http://www.globalenergy.com/
Transmission lines			
Substations			
Power plants			
Cities	Environmental Systems Research Institute (ESRI) (cities_dtl)	2000	http://www.esri.com/data/index.html
Populated Places	Environmental Systems Research Institute (ESRI) (placeply)	2000	http://www.esri.com/data/index.html

Table 5. Water energy resource site attributes used in development feasibility assessment.

Name	Description	Units
PEN_POWER_KW	Hydropower potential	kWa
PEN_TECH	Technology classification (LP or SH)	
FED_EXCLUDED	Stream reach intersects federal exclusion area (Y = yes, N = no)	
GAP_EXCLUDED ¹	Stream reach intersects a GAP area with GAP value of 1 or 2 (Y = yes, N = no)	
DEVELOPED	Stream reach is likely the site of an existing hydroelectric plant (Y = yes, N = no)	
ROAD_DIST_M	Distance to nearest road.	m
PLANT_DIST_M	Distance to nearest existing power plant.	m
SUBST_DIST_M ²	Distance to nearest substation.	m
PWRLN_DIST_M ¹	Distance to nearest power line.	m
POP_DIST_M	Distance to boundary of nearest populated area or city center.	m
Note 1: Data not available for Hawaii. Note 2: Data not available for Alaska and Hawaii.		

4. RESULTS

The discussion of results begins with an overview of the water energy resource site population that was assessed to identify feasible potential projects. This overview is followed by a discussion of the feasibility assessment results for the country presented in terms of numbers of feasible potential projects and their corresponding hydropower potential divided into power classes and into project size as designated by ranges of power potential. The results are then discussed from the perspective of their spatial distribution across the country by comparing results for each state and viewing the potential projects on a map. The last subsection discusses how the reader can access additional information about potential projects using a GIS application on the Internet called the VHP.

4.1 Power Category Distribution of Assessed Water Energy Resource Site Population

The water energy resource site population on which the feasibility assessment was performed included 500,157 sites representing a total gross power potential of 297,436 MWa. The distribution of these sites and their associated gross power potential on the basis of four categories:

- Developed
- Excluded
- Feasible
- Other available.

is shown in Figure 11. This figure shows that 127,758 sites having a total gross power potential

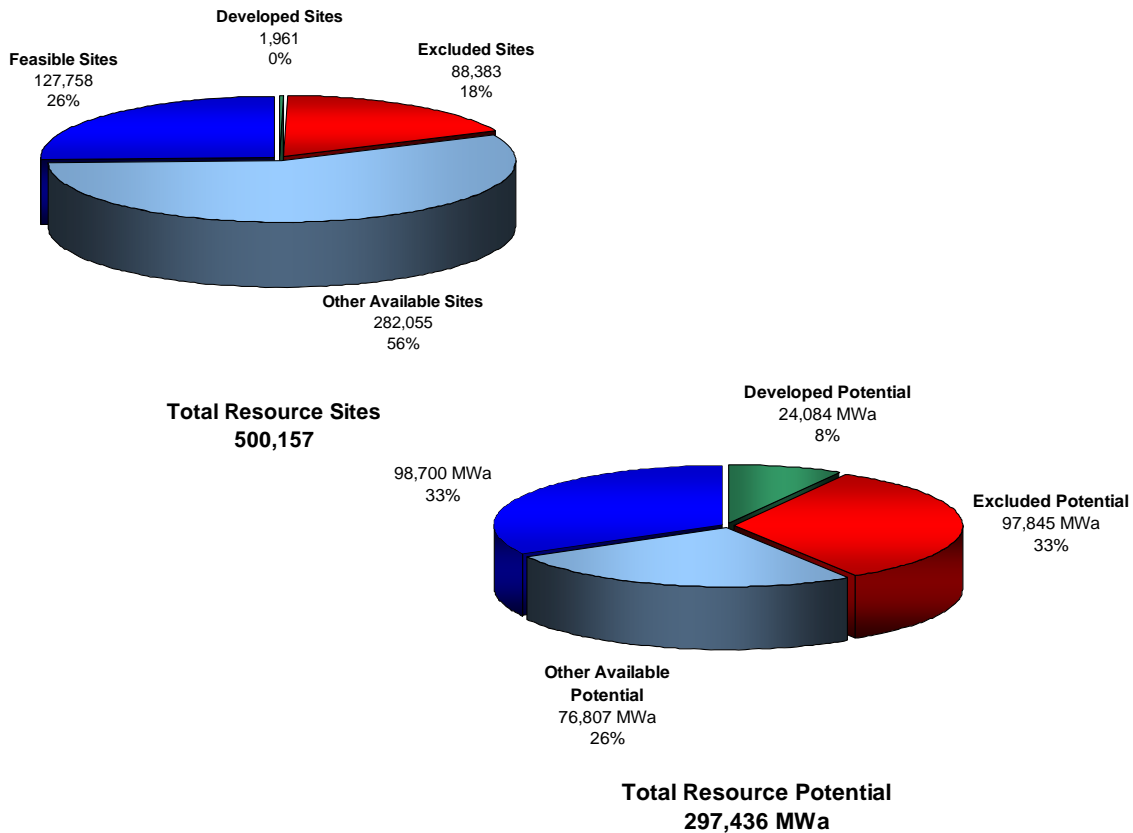


Figure 11. Power category distribution of water energy resource sites having gross power potentials greater than or equal to 10 kWa and their associated total gross power potential.

of 98,700 MWa were identified by the feasibility assessment as being sites for feasible potential projects. These sites constitute 26% of the site population and 33% of the total gross power, respectively.

The total power and its distribution shown in Figure 11 differ somewhat from results reported from the predecessor study (Hall et al. 2004). The total resource potential of 297,436 MWa is approximately 8,000 MWa higher than previously reported. This is the result of data refinements in the basic reach used in present study. The amount of excluded power increased in the present study by approximately 9,000 MWa because of the inclusion of environmentally sensitive areas, which added to the total area of zones in which hydropower development is unlikely. The amount of developed potential reported in the present study is approximately 10,000 MWa less than in the previous study. The methods of obtaining this value were different in the two studies. In the previous study, total average power for the U.S. hydroelectric plant population was used. This value was derived using the estimated average annual generation of each plant in the HPRA Database (FERC 1998), dividing this generation by the number of hours in a year to obtain plant average power, and summing all the plant values. In the present study, developed potential was determined by spatially relating water energy resource sites with existing hydroelectric plants, thereby identifying the gross power potential of sites corresponding to plant locations as developed potential.

Both methods of identifying developed potential have significant uncertainties. The estimated average annual generation in the HPRA Database is taken from the plant license application, if these data are provided. The value is the licensee's estimate of annual average generation at the time of application. Actual annual average generation could differ significantly over the period from when the application was filed to the present. If the average annual generation is not provided in the application, the value entered in the database is

calculated from the nameplate capacity, assuming a capacity factor of 1.0 — clearly an overestimation.

The uncertainty in developed potential derived in the present study stems from at least two known sources. Identifying water energy resource sites as developed based on collocation with a hydroelectric plant depends on having accurate plant geographic coordinates. It was found in many cases that these coordinates were not sufficiently accurate for this purpose. Large plant locations were manually verified to the extent possible using GIS tools to ensure the plant location was on a stream or located at the head of a reservoir. Still a search radius had to be used, and the nearest stream reach whose gross power potential and hydraulic head most closely matched the plant average power (derived from estimated average annual generation as stated above) and hydraulic head was considered the corresponding developed site and its potential the developed potential. It was also possible to miss developed potential for plants having reservoirs that extended for many miles upstream. These plants take advantage of elevation change occurring over miles of stream path, concentrating this elevation change at the dam to produce localized hydraulic head. Ideally, the existence of the reservoir is captured in the digital elevation model (DEM) that was used to derive the synthetic hydrography, which provided the hydraulic head and consequently the gross power potential for a water energy site in our study. If the presence of the reservoir is included in the DEM, a synthetic stream reach will have the local elevation change at the dam. However, if the DEM does not reflect the presence of the reservoir or its full extent, but rather reflects the topography underlying the reservoir, some of the upstream stream reaches that should have been flagged developed will be missed and thus reduce the total developed potential. Considering the uncertainties in both methods, it is best to consider values from the two methods as upper and lower bounds of the developed potential. In a worst case, the total available potential (feasible and other available) of 175,507 MWa would be reduced by 10,000 MWa.

4.2 Power and Technologies Class Distribution of Feasible Potential Projects

The nearly 130,000 feasible potential projects identified in the study were classified as either low power (hydropower potential less than 1 MWa) or small hydro (hydropower potential greater than or equal to 1 MWa, but less than or equal to 30 MWa). The low power projects were further subdivided using the operating envelopes of classes of low power technologies shown in Figure 12. The hydropower potential and working hydraulic head of the potential project were used to assign technologies class. The unconventional systems class of technologies, which is delineated by the working hydraulic head being less than 8 ft, is intended to show that if the potential is going to be realized, it will require the use of an ultra low head turbine or hydrokinetic technology. It is not known from the assessment performed whether

there is sufficient velocity at the site to make a hydrokinetic installation viable.

The power potential of U.S. water energy resource sites is presented in power categories and is divided by power classes and classes of low power hydropower technologies in Table 6. The power values listed for the power categories “Total” through “Feasible” are total gross power potential values for a group of water energy resource sites. The values listed for each power category “Developed” through “Feasible” for a particular power class^d (e.g., “Small Hydro”) correspond to a subset of the water energy resource sites whose total gross power potential is listed under the “Total” power category. The sites corresponding to the values listed in the “Feasible” category are a subset of those corresponding to the values listed under the “Available” category.

The power values listed under “Potential Projects” are hydropower potential values. They

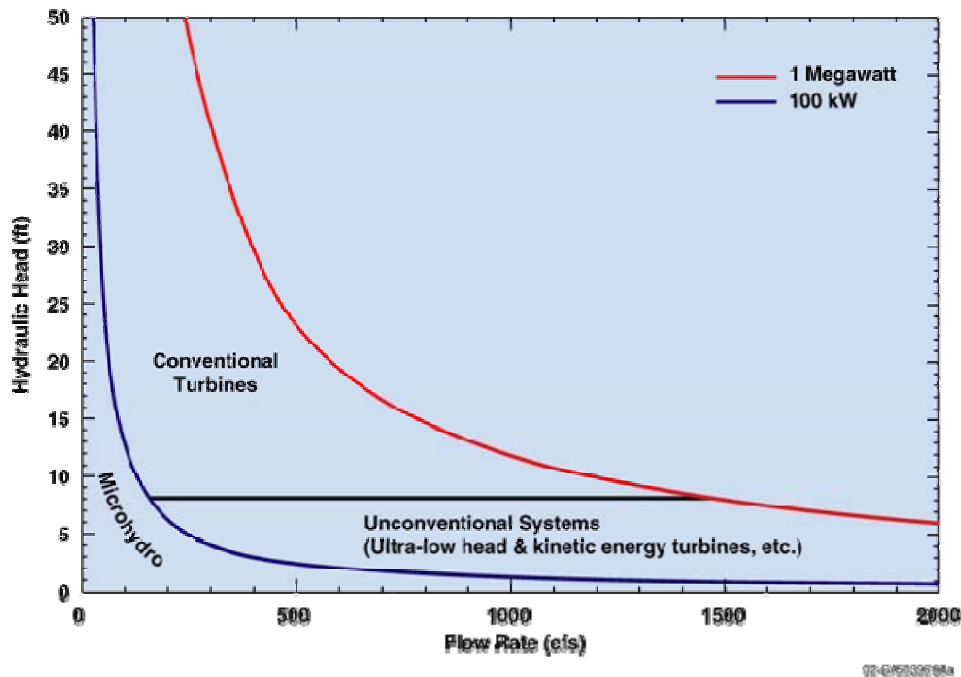


Figure 12. Operating envelopes of three classes of low power technologies.

d. The low power technology classes were assigned to water energy resource sites and their cumulative power potential by using the operating envelopes shown in Figure 12, but were based on reach hydraulic head and full flow rate rather than working hydraulic head and flow rate, which were used to classify low power potential projects.

Table 6. Power potential of U.S. water energy resource sites in power categories divided into power classes and low power technology classes.

Annual Mean Power (MWa)	Total	Developed	Federally Excluded	GAP Excluded	Available ^a		Feasible ^b		Potential Projects ^c
Total Power	297,436	24,084	84,682	13,163	175,507		98,700		29,438
Total High Power	237,193	23,786	73,591	10,097	129,719		75,853		18,450
Large Hydro	77,187	19,380	17,600	2,307	37,900		21,691		0
Small Hydro	160,006	4,406	55,991	7,790	91,819		54,161		18,450
Total Low Power	60,243	298	11,091	3,066	45,788		22,848		10,988
Conventional Turbines	45,208	241	9,517	2,426	33,024		17,729		6,297
Unconventional Systems	3,986	37	520	187	3,243		2,355		1,640
Microhydro	11,049	20	1,054	453	9,522		2,763		3,052

Note: Power potential in power categories "Total" through "Feasible" are gross potential. Power potential in "Potential Projects" category is hydropower potential based on development criteria.

^a "Available" only indicates net gross power potential after subtracting developed and excluded potentials from total potential.

^b "Feasible" is gross power potential of water energy resource sites that are feasibly developable based on stated feasibility criteria.

^c "Potential Projects" is hydropower potential based on development criteria being applied to feasibly developable water energy resource sites.

do not correspond to a subset of the water energy resource sites reflected in the "Total" power category for a given power or technology class. This is because application of the development criteria produced hydropower potential values that were significantly less than the gross power values. Thus, water energy resource sites that were power classed based on their gross power potential were not necessarily in the same power class based on their hydropower potential. For example, all the

sites that were classed as "Large Hydro" based on their gross potential became "Small Hydro" or "Low Power" potential projects.

The distribution of feasible potential project sites and their associated hydropower potential is shown in Figure 13. This figure shows the results of applying the development criteria to obtain better estimates of hydropower potential. The nearly 130,000 feasible project sites, which had a total gross power potential of nearly

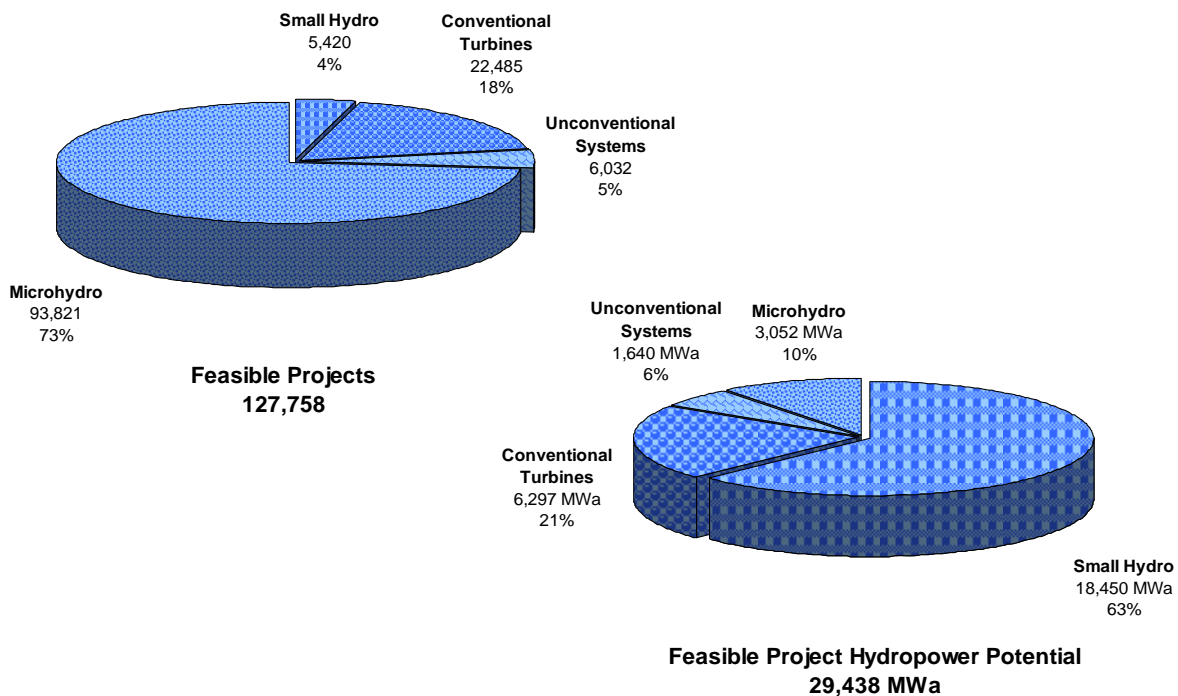


Figure 13. Power category distribution of feasible potential projects and their associated total hydropower potential with low power projects further divided by low power technology classes.

100,000 MWa, were found to realistically offer 30,000 MWa of hydropower potential. This is not surprising considering that the development criteria of using half the site's flow or less resulted in at least halving of the possible amount of hydropower potential compared to the gross power potential. The working flow rate restriction may be overly conservative resulting in more total hydropower potential than that estimated by the study. The methodology used in the study also did not explicitly evaluate hydrokinetic potential at sites where there may be little or no elevation difference, but sufficient velocity and stream depth to support energy extraction using hydrokinetic technologies.

It is essential that the total hydropower potential of approximately 30,000 MWa not be interpreted to be same as 30,000 MW of likely capacity increase potential identified in a site-based resource assessment conducted during the 1990s by INL (Connor et al. 1998). While the numerical values are the same, the units and associated generation potential are not. The hydropower potential estimated by the present study is annual mean power. This power value translates directly to generation power when multiplied by the number of hours in a year (8760 hr). In contrast, the total capacity increase potential identified in the prior study requires the application of a capacity factor to estimate the corresponding potential generation. Considering that the average capacity factor for the U.S. plant population is 50%, the capacity increase potential corresponds to a 15,000-MW increase when viewed as annual average power. Conversely, the 30,000 MWa identified in the present study could imply a 60,000-MW increase in capacity. It is not

anticipated that this large an increase in capacity would be required in light of the development assumption of only using part of the stream flow, which would allow the identified potential projects to operate at higher capacity factors.

The information shown in Figure 13 is put in perspective by comparison with information about the present U.S. plant population shown in Figure 2. The 30,000 MWa of hydropower potential estimated by this study is comparable to the total average power of the existing plant population, which is between 25,000 and 35,000 MWa as discussed above. However, considering that the present plant population numbers on the order of 2,400 plants (not counting pumped storage plants), it is clear that 130,000 projects will not get built in the foreseeable future, which would double U.S. annual hydropower generation. The fact that the study identified this many feasible projects does indicate a significant number of opportunities for new hydropower development. Development that is more realistic is represented by the 5,400 new small hydro projects identified by the study as shown in Figure 13. These potential projects represent nearly 20,000 MWa of hydropower potential, which would increase in U.S. annual hydropower generation by more than 50%, if they were developed.

The distribution of potential low power projects on the basis of the number of projects and their corresponding hydropower potential in 100-kW bins ranging from 100 to 1,000 kW is shown in Figure 14. Most of the 122,338 potential projects in this power class are microhydro projects (hydropower potential less than 100 kW)

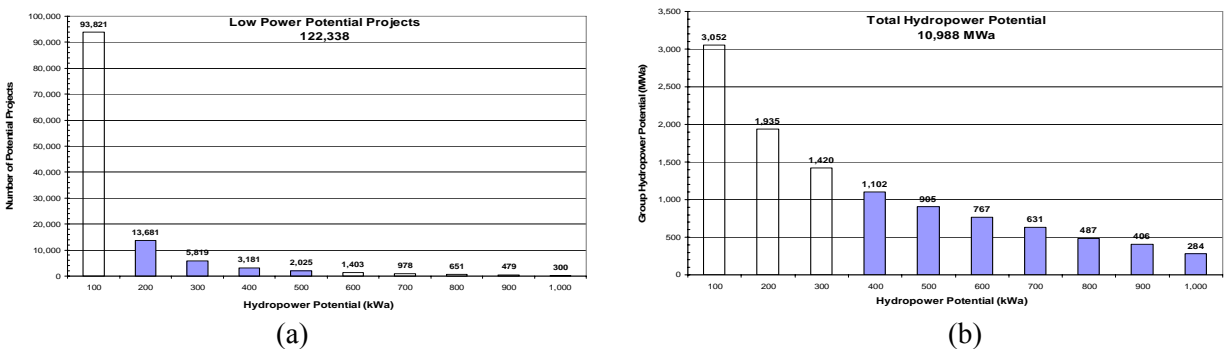


Figure 14. Distribution of (a) number and (b) group hydropower potential of U.S. low power potential projects.


representing approximately 30% of the total hydropower potential for this class of potential projects. The remaining 28,517 potential projects representing approximately 8,000 MWa of hydropower potential have power potentials between 100 and 1000 kWa.

Similar distributions for small hydro potential projects are shown in Figure 15 in which the bins are 2 MWa, ranging from 2 to 30 MWa. Again, the potential projects at the lower end of the power class constitute most of the population. There are 4,375 potential small hydro projects or 80% of the population having hydropower potentials in the range from 1 to 4 MWa. These projects represent slightly over 40% of the total small hydro hydropower potential. The remaining hydropower potential of 13,000 MWa corresponds to 1,045 potential projects ranging from 6 to 30 MWa. At the upper end of the power class, 78 potential projects having hydropower potentials between 28 and 30 MWa represent a total hydropower potential of 2,330 MWa. Most of these projects correspond to using just enough flow rate to produce 30 MWa from larger streams where use of half the flow rate would result in development of a large hydro class project. The approximately 5,000 potential small hydro projects identified in the study represent the group of projects that would most efficiently increase U.S. hydropower generation.


4.3 Spatial Distribution of Water Energy Resources and Potential Projects

The total gross power potential of water energy resource sites in each of the 50 states of the United States is shown in Figure 16. The total state gross power potential is divided into the potential that could feasibly be developed, other available potential that has not been developed and is not excluded from development, potential that is excluded from development either because it is in a zone where federal land use or environmental sensitivity make development unlikely, and potential that has already been developed corresponding to existing hydroelectric plants. This figure shows that six western states, Alaska, Washington, California, Idaho, Oregon, and Montana, have significantly more gross power potential than the other 44 states. For the vast majority of the states (42) the feasible gross potential is more than half of the available gross potential. The average percentage of available gross potential that is feasible is 71%.

Alaska is outstanding both because of its vast power potential (on the order of three times any other state) and because its feasible gross potential is only 14% of that available. Nearly half of the state's power potential lies within zones where development is unlikely. These characteristics of the state's water energy resources are understandable in light of its large area, extent of mountainous terrain, prevalence of protected areas, and remote location of many resources.

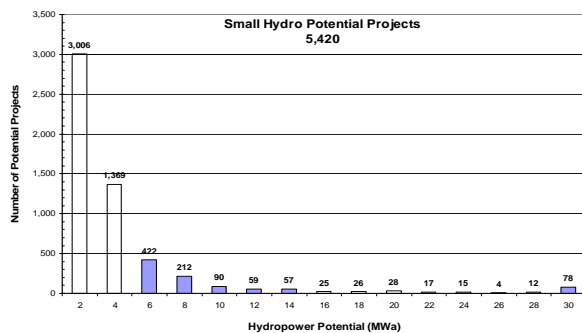

(a)

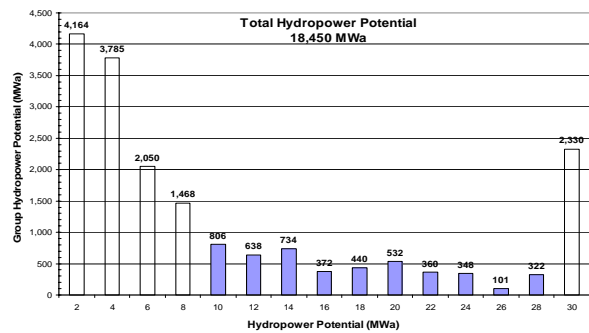

(b)

Figure 15. Distribution of (a) number and (b) group hydropower potential of U.S. small hydro potential projects.

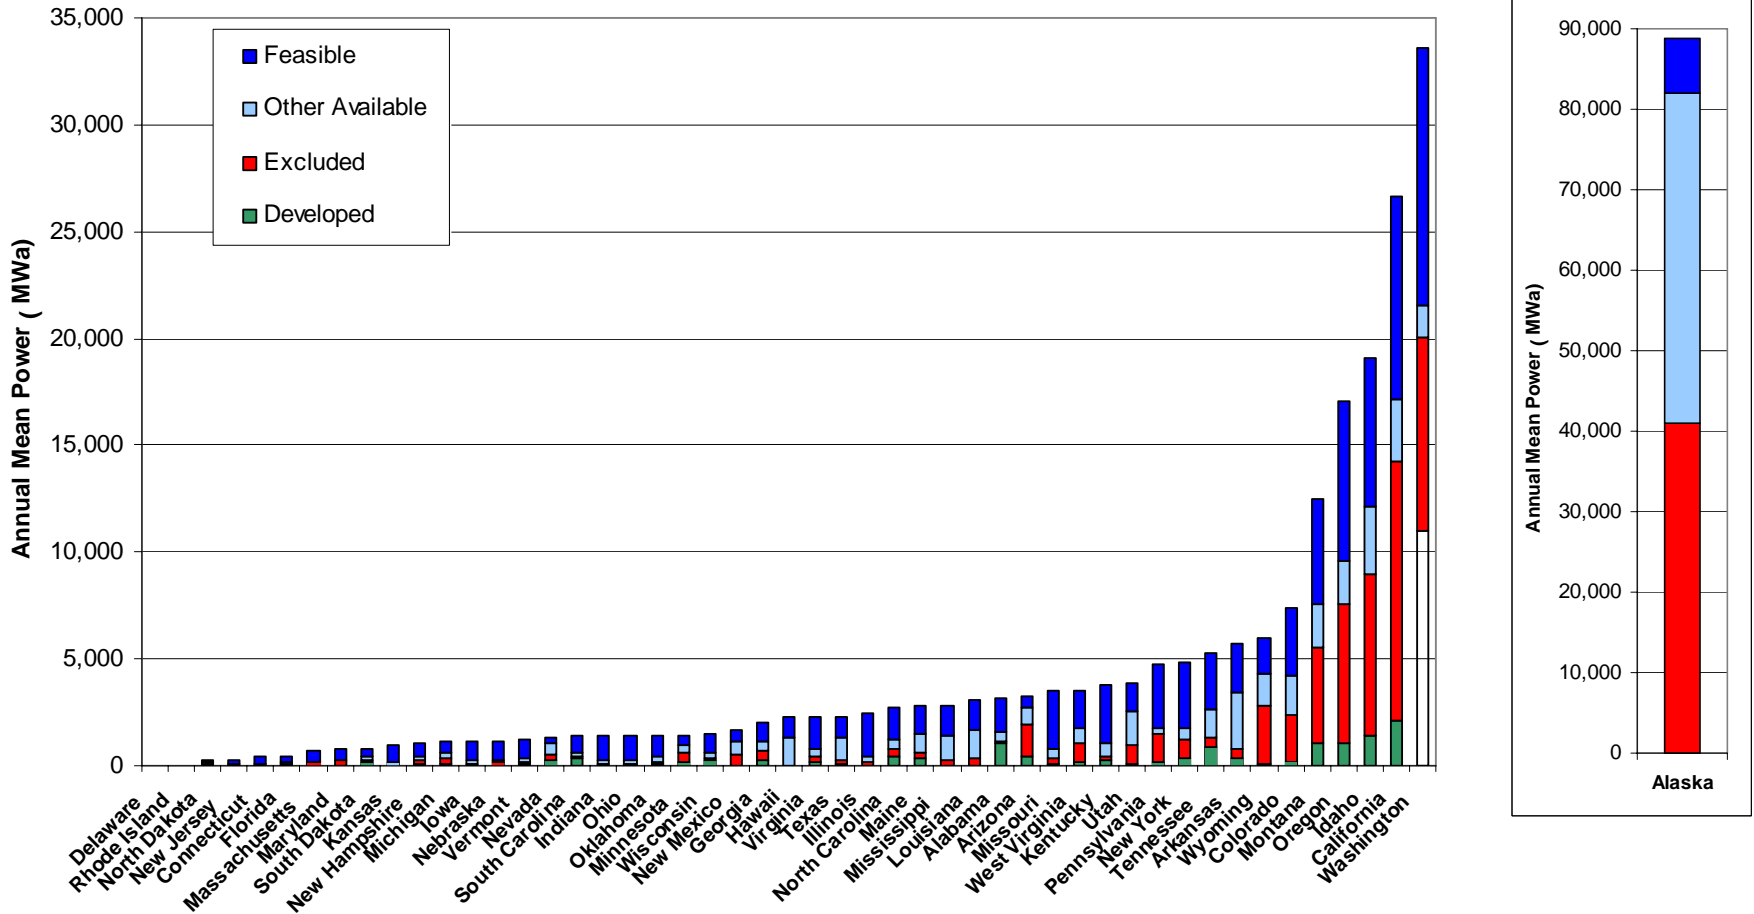


Figure 16. Total gross power potential of water energy resources in the 50 states of the United States divided into feasible, other available, excluded, and developed power categories.

The gross power potential for each state shown in Figure 16 can also be viewed from the perspective of power density by dividing each state's gross power potential by its planimetric area. The result shown in Figure 17 provides an indication of the density of water energy resources in the state. From this perspective, Washington and Hawaii have significantly higher power densities than the other 48 states. This is the result of high rainfall coupled with significant elevation differences in the topography.

The total hydropower potential of feasible potential projects in each of the 50 states of the United States is shown in Figure 18. The total hydropower potential of each state is divided into that corresponding to low power and small hydro potential projects. The same six western states that were found to have the most gross power potential were found to have the most hydropower potential, but not in the same order. While Alaska had by far the most gross power potential, California was found to have the most hydropower potential when feasibility is considered. For most states, most of the hydropower potential was associated with potential small hydro projects (on average 63% of the total hydropower potential compared to the remaining 37% associated with potential low power projects).

The hydropower potential of feasible potential projects in each state is put in perspective by comparing to the total average power of the existing hydroelectric plants in the state. Table 7 provides this comparison and shows what

percentage increase in generation would be achieved if all the potential projects identified in the state were developed. For this comparison, the higher estimates of annual average power derived from the estimated annual generation listed in the HPR Database (FERC 1998) were used to be conservative. The data in Table 7 show that 33 states would increase their hydropower generation by 100% or more and 41 states would increase their generation by more than 50% if all the potential projects identified in the state were developed.

As with gross power potential, it is useful to know what states have the highest concentrations of hydropower potential. This view is provided by Figure 19. The same two states, Washington and Hawaii, that have outstanding concentrations of gross power potential, also have outstanding concentrations of hydropower potential, but in reverse order. Hawaii has the distinction of having the highest concentration of hydropower potential, followed closely by Washington. Seven states: Idaho, Vermont, California, Oregon, Connecticut, Pennsylvania, and West Virginia make up the next tier of states having power densities greater than 20 kW/sq mi with Idaho being the only one of this group that exceeded 25 kW/sq mi.

The locations of the 127,758 potential project sites are shown on the map in Figure 20. Project sites are differentiated by whether they are small hydro or low power sites. The low power sites are further differentiated by low power technology class. The 2,391 existing hydroelectric plants are

Table 7. Comparison of hydropower potential of feasible potential projects with total annual average power of hydroelectric plants in each of the 50 states of the United States.

State Name	Developed Hydropower (MWa)	Feasible Potential Hydropower (MWa)	Potential Hydropower Increase	State Name	Developed Hydropower (MWa)	Feasible Potential Hydropower (MWa)	Potential Hydropower Increase	State Name	Developed Hydropower (MWa)	Feasible Potential Hydropower (MWa)	Potential Hydropower Increase
Delaware	0	6	∞	Utah	135	401	297%	New Hampshire	187	174	93%
Mississippi	0	298	∞	Virginia	147	418	284%	California	4699	3,425	73%
Kansas	1	295	29451%	Florida	32	79	245%	Michigan	209	133	64%
Illinois	27	568	2103%	Nebraska	152	354	233%	Oregon	3271	2,072	63%
Alaska	171	2,694	1575%	Connecticut	55	105	191%	Tennessee	1082	655	61%
Hawaii	20	280	1400%	Texas	189	328	174%	North Carolina	610	348	57%
New Jersey	6	63	1057%	Vermont	128	217	170%	Georgia	429	230	54%
Missouri	129	798	618%	Idaho	1288	2,122	165%	South Carolina	428	211	49%
New Mexico	30	156	519%	Rhode Island	4	7	163%	Maryland	203	91	45%
Ohio	63	319	506%	Arkansas	405	590	146%	Alabama	1113	462	41%
Indiana	67	305	455%	Oklahoma	239	345	144%	Nevada	263	95	36%
Wyoming	117	507	433%	Montana	1192	1,669	140%	Washington	11470	3,106	27%
Colorado	246	891	362%	Kentucky	383	518	135%	New York	2861	757	26%
Iowa	95	329	347%	Minnesota	128	140	109%	South Dakota	622	119	19%
West Virginia	140	484	346%	Massachusetts	126	136	108%	Arizona	928	150	16%
Louisiana	89	306	343%	Maine	432	432	100%	North Dakota	270	40	15%
Pennsylvania	284	953	336%	Wisconsin	264	259	98%				

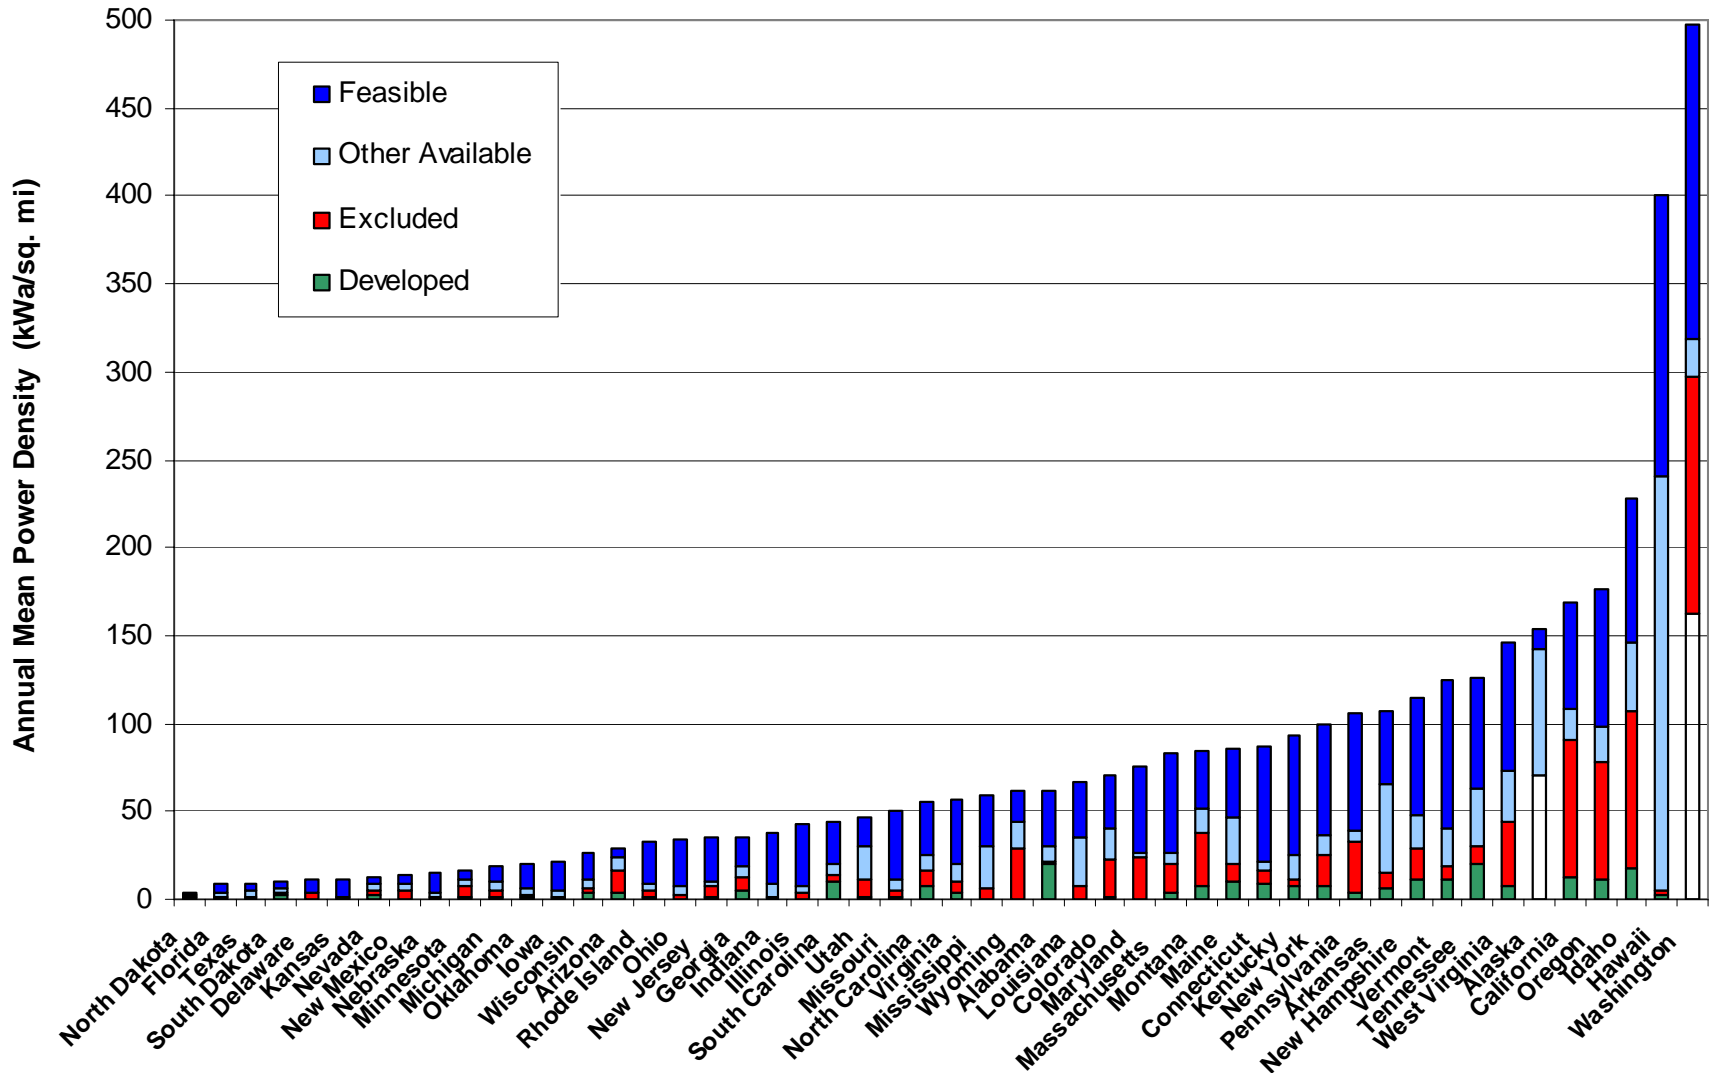


Figure 17. Total gross power potential density of water energy resources in the 50 states of the United States divided into feasible, other available, excluded, and developed power categories.

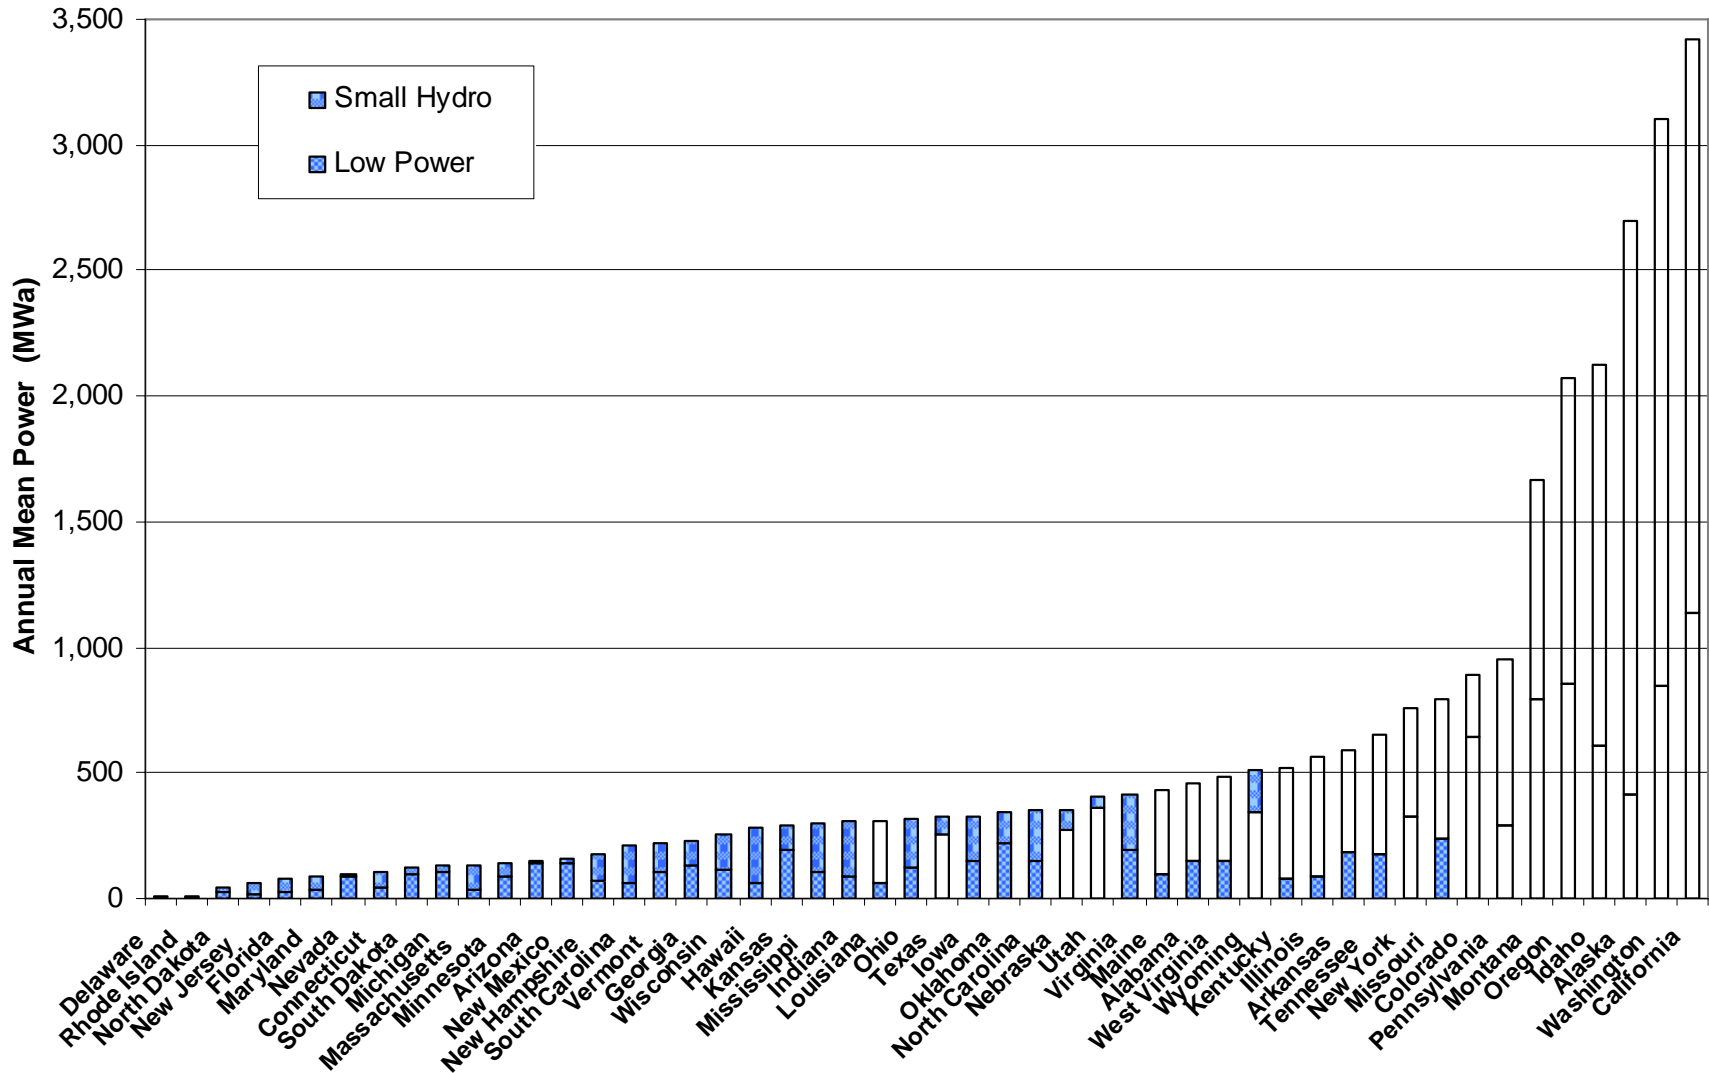


Figure 18. Total hydropower potential of feasible low power and small hydro projects in the 50 states of the United States.

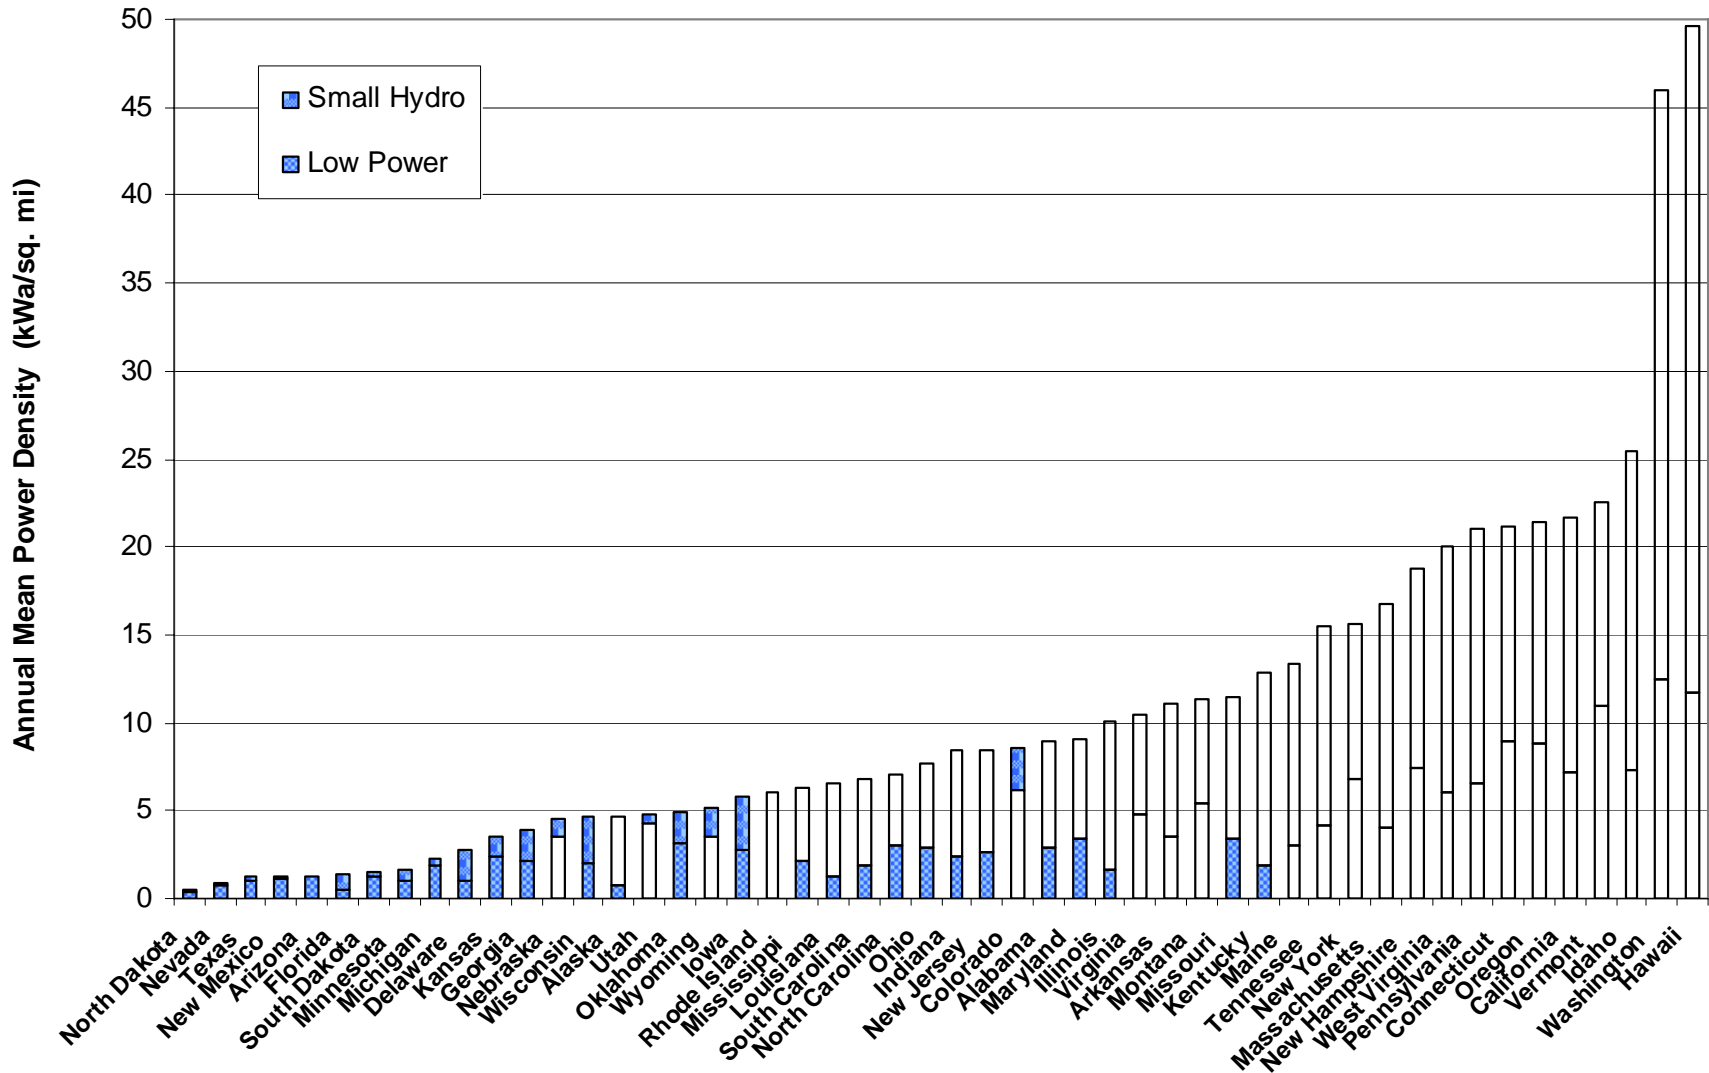


Figure 19. Total hydropower potential density of feasible low power and small hydro projects in the 50 states of the United States.

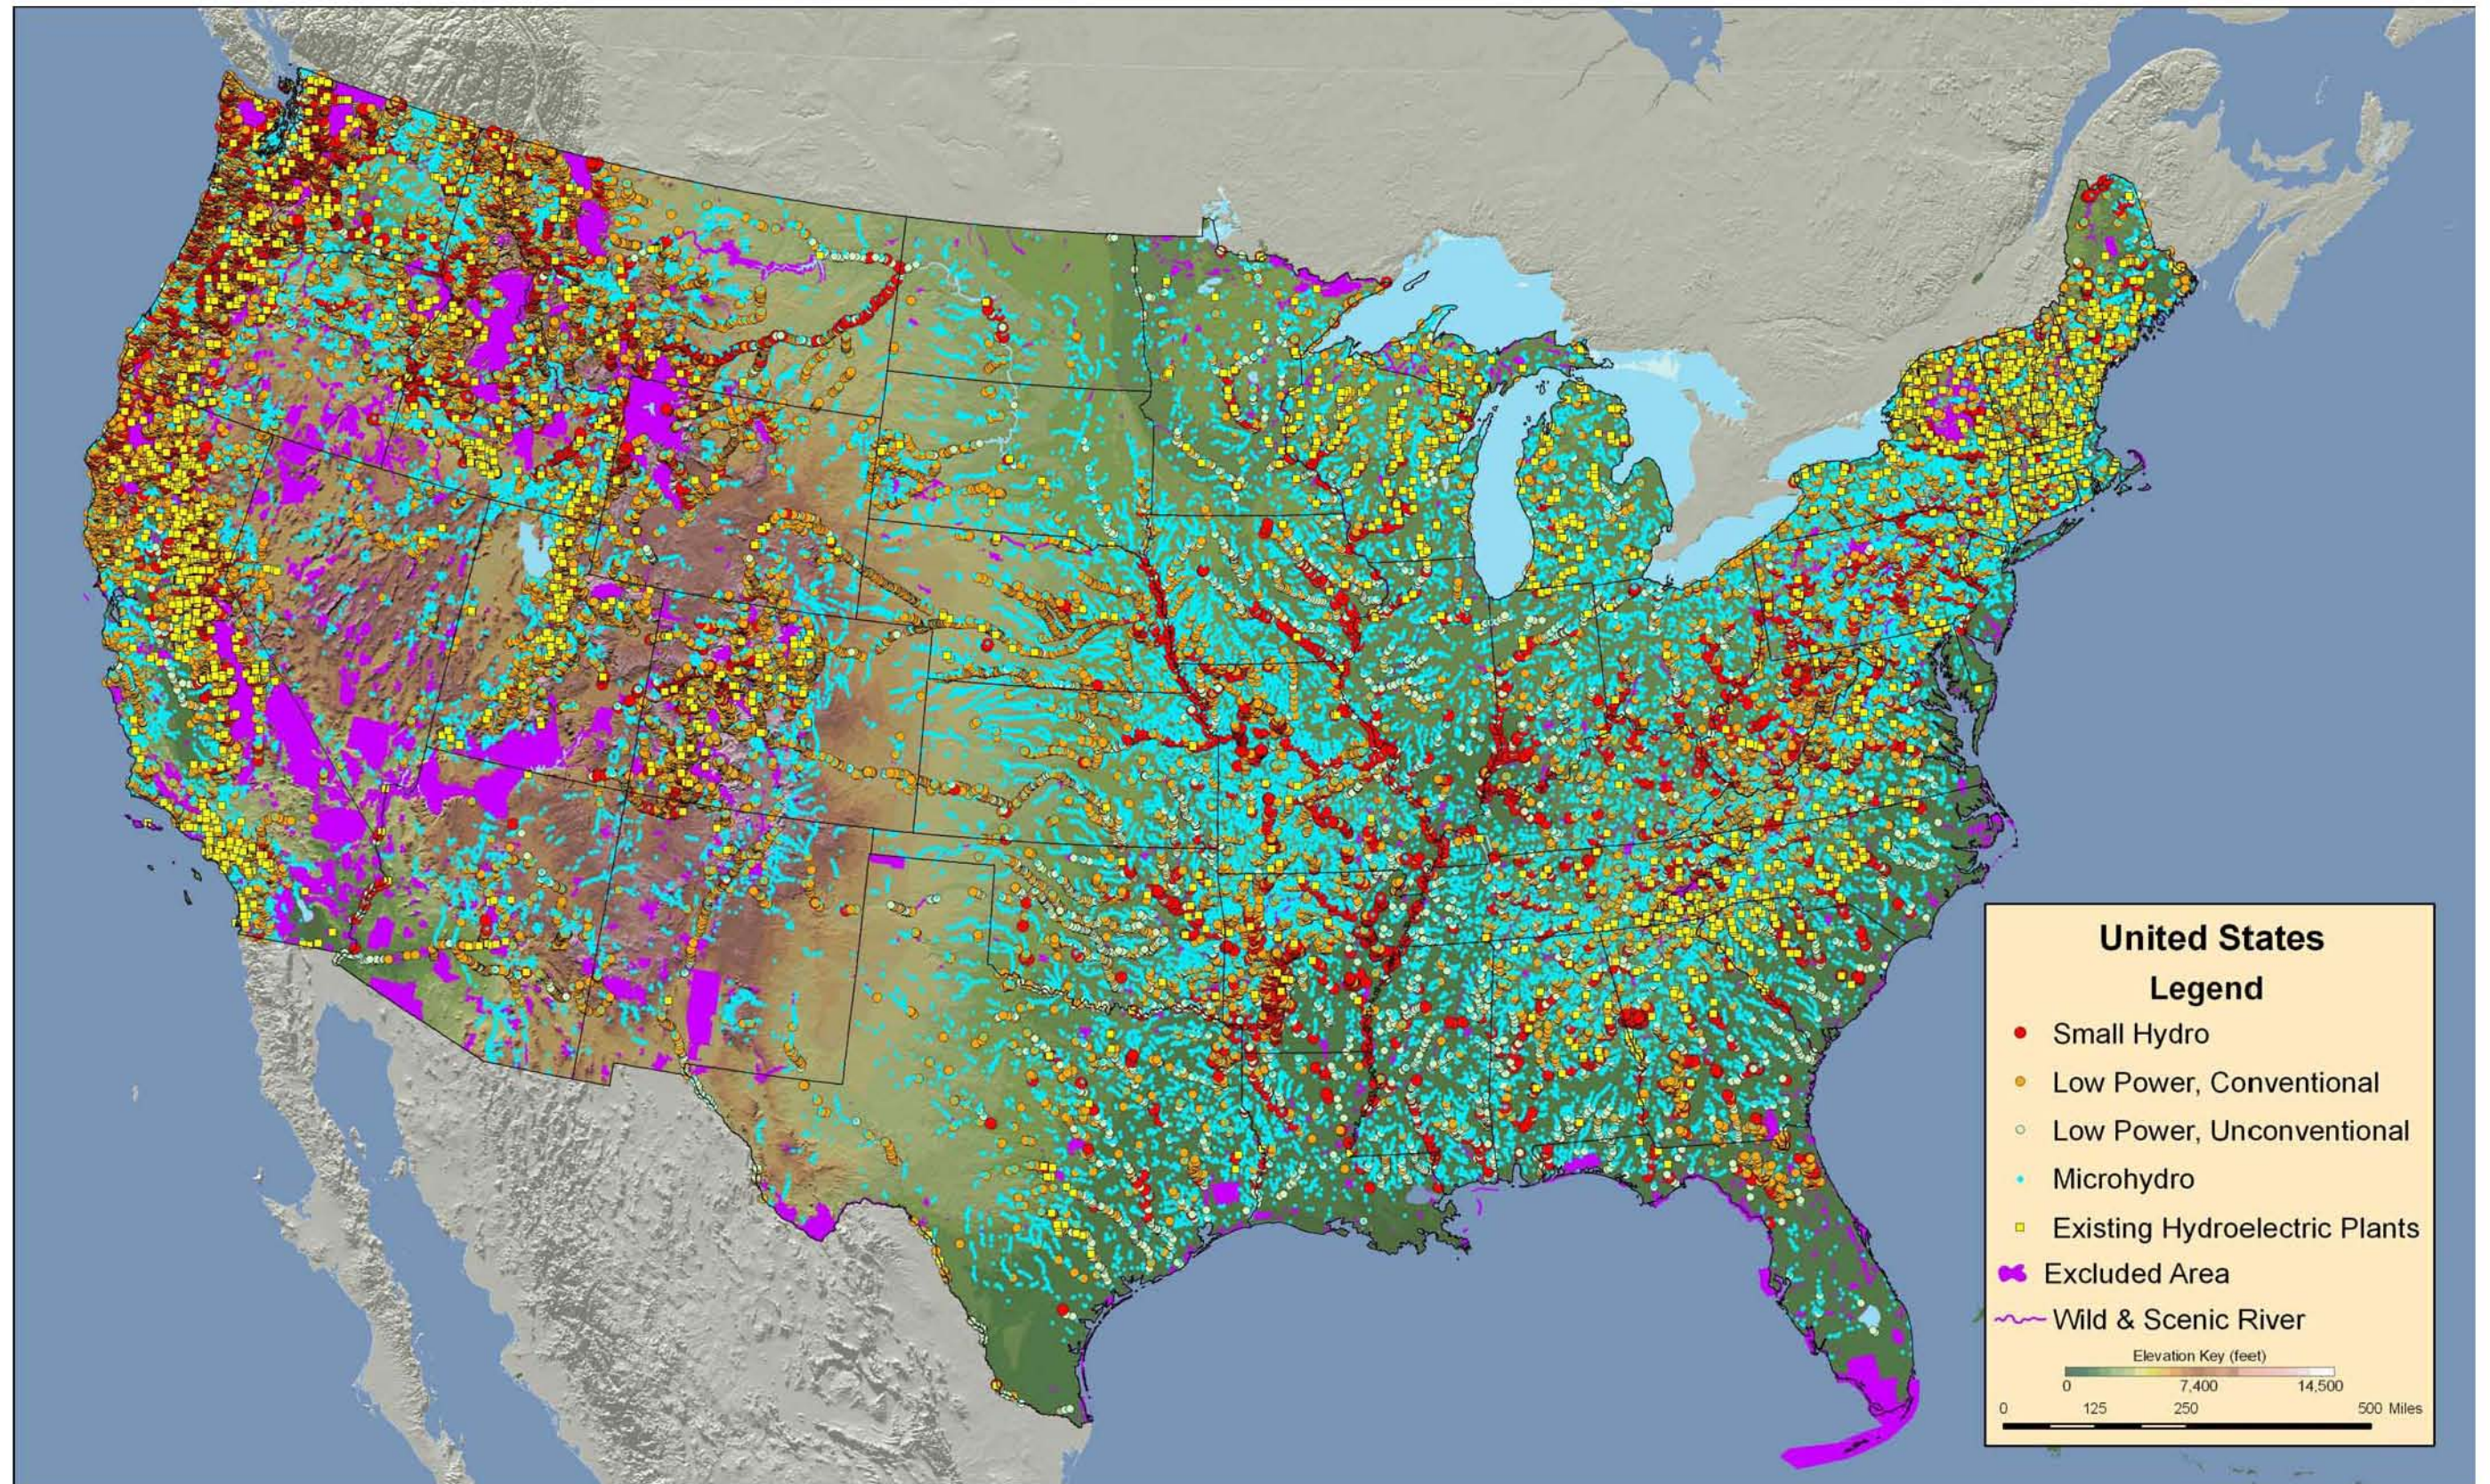


Figure 20. Existing hydroelectric plants and feasible potential hydropower projects in the United States.

also shown on the map. Figure 20 provides an indication of the location of the project sites and visual image of their concentration. Every state contains some potential project sites. It is clear from the map and Figure 19 that eight states, North Dakota, Nevada, Texas, New Mexico, Arizona, Florida, South Dakota, and Minnesota, have notably low concentrations of project sites in at least part of the state. Other than these states, most states have significant numbers and concentrations of potential project sites including Texas, whose potential projects happened to be concentrated in the eastern part of the state. Considering only small hydro and low power, conventional turbine project sites, the map shows that sites abound East of the Mississippi River particularly in the Appalachian Mountains, on tributaries of the Mississippi River, in the Rocky Mountains, in the Sierra Mountains, and in the Coastal Ranges in California, Oregon, and Washington.

Summaries addressing the water energy resources and feasible potential projects in each state are provided in Appendix B. These summaries include tabular data and graphical presentations of the gross power potential of state water energy resources by power category and the hydropower potential of potential projects by power class. Distributions of the number and group hydropower of low power and small hydro potential projects are presented in ranges of hydropower potential. These distributions show relative numbers of projects of various sizes and their contribution to the total, power class, hydropower potential. Each summary concludes with a state map showing the locations of low power and small hydro potential projects.

4.4 Potential Project Location and Attributes Provided by the Virtual Hydropower Prospector

In order to go beyond the summary data presented in this report and present information about individual water energy resource sites and potential projects, the data used and produced in this study were incorporated into a GIS application and made publicly available on the Internet. This application is called the VHP, and it is accessible at <http://hydropower.inl.gov/prospector/>. The VHP desktop displaying a map of the Pacific Northwest Region is shown in Figure 21. Its purpose is not only to display water energy resource sites and potential projects on regional maps and provide extensive attribute information about them, but also to show sufficient context features so that the application user can perform preliminary, customized feasibility assessments. For this purpose, the user can elect to display the following context features:

- Hydrography
- Power system (hydroelectric plants, other power plants, transmission lines, and substations)
- Transportation (roads and railroads)
- Areas and places (city centers; populated areas; county, state, and hydrologic region boundaries)
- Land Use (exclusion zones based on federal and statutes and policies and environmental sensitivities; and land that is the purview of federal agencies including: Bureau of Indian Affairs, Bureau of Land Management, Bureau of Reclamation, Department of Defense, U.S. Forest Service, U.S. Fish & Wildlife Service, U.S. Park Service).

In addition to displaying these features on the map, attribute information about them is also provided by the application.

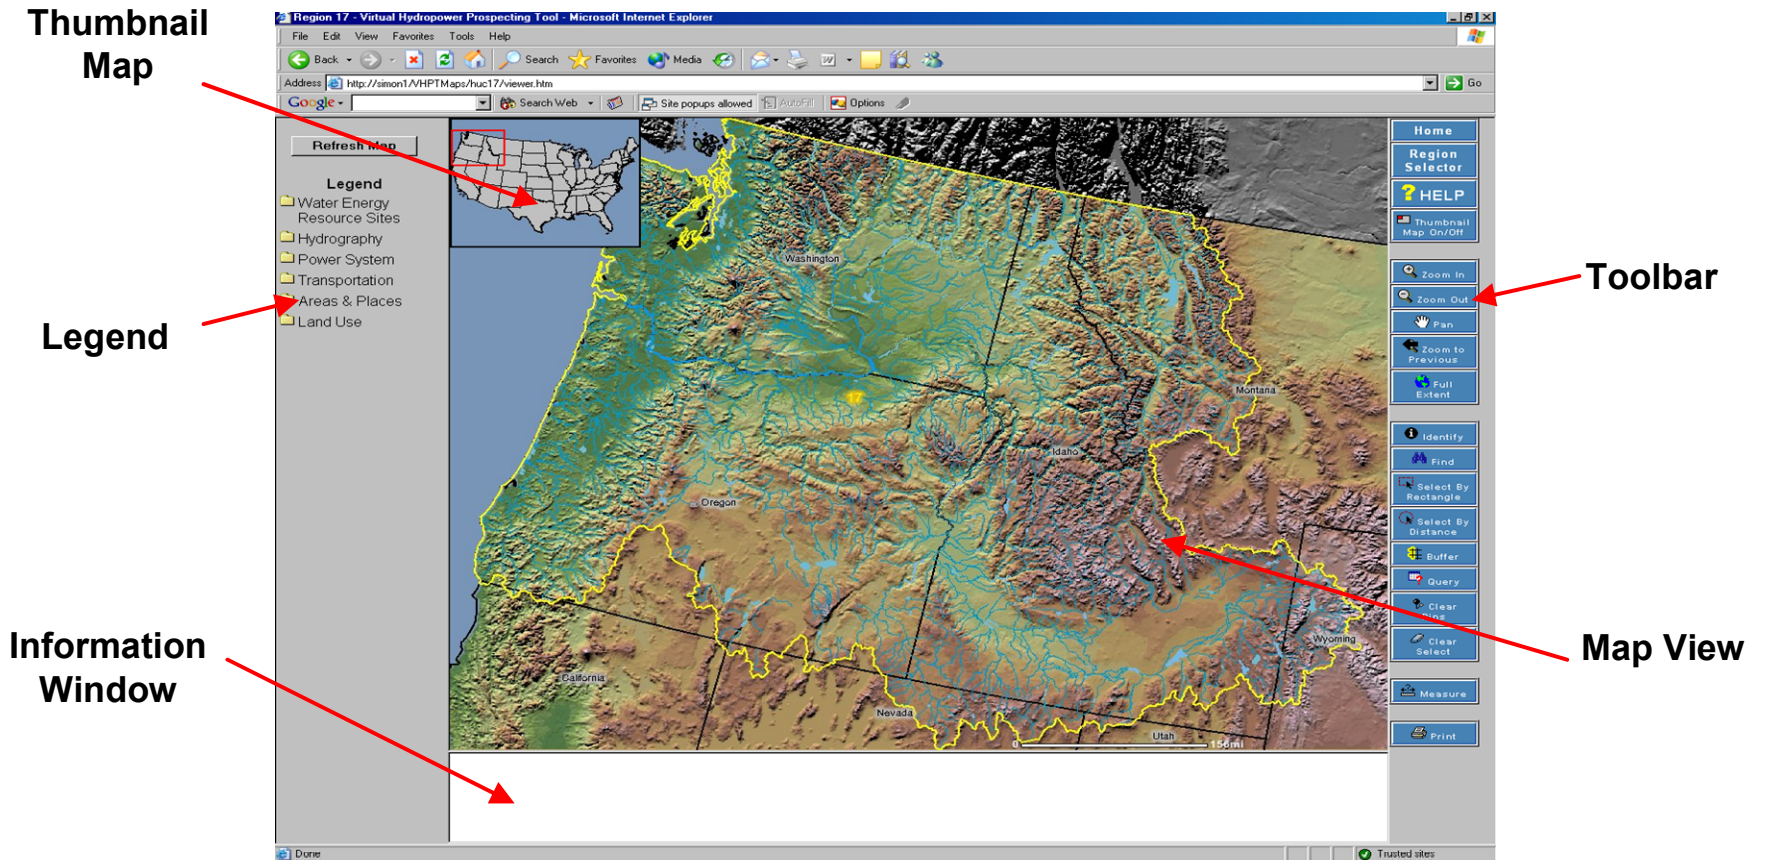


Figure 21. Desktop of the Virtual Hydropower Prospect GIS application showing its areas for display and control.

5. CONCLUSIONS

This study has refined the results of the previous assessment of the water energy resources of the United States (Hall et al. 2004) by accounting for environmentally sensitive areas as zones in which hydropower development is unlikely. It has extended the previous study by identifying water energy resource sites that are feasible to develop and estimated their hydropower potential based on a realistic development model and associated development constraints. Of the approximately 300,000 MWA of total, gross power potential of U.S. natural stream water energy resources, only about 10% has been developed. About 30% are located in zones where development is unlikely. The remaining 60% of over 170,000 MWA have not been developed and are not restricted from development based on information sources used in the assessment. Of this potential, it was found that nearly 100,000 MWA of gross power potential could feasibly be developed. This feasible potential corresponds to nearly 130,000 potential low power and small hydro projects. Estimation of the hydropower potential of these sites indicates 30,000 MWA of new power supply could feasibly be developed in the United States.

There are a large number of feasible potential projects to choose from, and they are located such that most states could benefit from a significant amount of additional renewable energy if they were developed. Development of the 5,400 feasible small hydro projects alone would provide more than a 50% increase in U.S. hydroelectric generation. Six western states, California, Washington, Alaska, Idaho, Oregon, and Montana, have potential project sites representing particularly high amounts of hydropower potential. With the exception of Washington, which already has the highest amount of hydroelectric generation among the states by a wide margin, these states have sufficient hydropower potential to increase their generation by between 60 and 1600%. Alaska has sufficient hydropower potential to increase its hydroelectric generation by nearly a factor of 16. Hawaii is also noteworthy, because it has the highest density of potential projects, which if developed, would also increase its hydroelectric generation by more than a factor of ten. Beneficial increases are not limited to just the western states.

This study has shown that 41 states distributed around the country have sufficient potential to increase their generation by at least 50%. These facts illustrate that beneficial renewable water energy resources are under utilized throughout most of the country.

The development model used to assess hydropower potential is a configuration not requiring a total obstruction of the water course or the creation of a reservoir. Eighty-four percent of the identified hydropower potential could be developed using existing technology. Of the current U.S. hydroelectric plant population, 92% are small hydro or low power plants based on their annual average power. These facts illustrate that while research and development may lead to new configurations, use of new materials, and increased efficiencies, significant gains in generation can be achieved without large research and development investments or the need to demonstrate that low power and small hydro plants are technologically feasible.

Water energy resource sites were designated as being feasible for development in this study based on a set of feasibility criteria. Local land use, policies, and environmental sensitivities not accounted for in the study may render some of the identified potential projects unfeasible. Economic factors may also affect the development viability of some sites. The study also did not include a comprehensive assessment of the economic viability of the identified potential projects. An elementary consideration was given to acceptable costs of site accessibility and power transmission. However, the costs of licensing, construction, mitigation, operation and maintenance, availability of financing, and the potential income from purchased power were not evaluated. Current trends may make projects that are not economically viable now become viable in the future. These trends include: the rising cost of fossils fuels, the establishment of state renewable portfolio standards, carbon credits, transmission grid load and energy security considerations favoring distributed generation, and federal incentives to promote sustainable energy production and U.S. energy independence.

The hydropower potential of feasible potential projects was based on a development model and restrictions on working flow rate and hydraulic head. Equipment efficiency and penstock pressure losses were not included, which would reduce estimated hydropower potentials. While annual mean flow rates were used to estimate power potential, water availability based on flow duration was not. Some sites could be rendered unfeasible when equipment related power losses and water availability are included in the feasibility assessment. Counterbalancing these power potential reducing factors are the facts that more than half the stream flow may be available for power generation at some sites, thus increasing both power potential and availability. Dams may exist at some sites, increasing the power potential because of the existence of more hydraulic head than was estimated and increasing the likelihood of development due to previously mitigated environmental concerns and significantly reduced development costs.

This study and the companion development of a publicly available GIS application on the Internet has shown that the value of research can be enhanced and extended by providing access to detailed information and tools for individuals to further research the subject matter from their perspective. The ultimate value of the study is the conclusion that sufficient, untapped power potential from water energy resources exists in most places in the United States to warrant further evaluation as sources of sustainable energy production and has shown the most likely locations meriting further evaluation. The Virtual Hydropower Prospector GIS application on the Internet provides a tool for customized preliminary site evaluations. However, site specific evaluations of development feasibility and power potential considering engineering and economic aspects of the potential project are essential.

6. RECOMMENDATIONS

The feasibility assessment that has been performed could be further refined to address additional factors including:

- Equipment efficiencies and energy losses
- Resource duration and availability
- Local land use and environmental sensitivities
- Economic feasibility considering development costs and incentives, power marketing, and available financing.

Incorporation of these additional factors for all the potential projects identified by the screening performed in the present study would require significant funding. As with any federally funded research and development, there is the question of at what point research that could not be funded by industry has been completed and sufficient information has been provided to enable industry to explore and develop specific opportunities. The need for federally funded refinement of the feasibility assessment is not clear. Such refinements are possible, but are probably dependent on an expression of industry need.

The usefulness of VHP GIS application could be enhanced by several upgrades. At present, the application displays color-coded, shaded relief only when a large area is displayed. The relief is turned off when the user zooms into a local area because the relief is based on 1 km DEMs, resulting in distracting pixilation beyond a certain level of zoom. The relief display could be upgraded using GIS data layers based on at most 90 m DEMS, allowing the user to view the topography of local areas and be better able to evaluate topographic implications affecting development. Additional feature sets and references that could be added include:

- Locations and attributes of all existing U.S. dams from the National Inventory of Dams
- Reference added to site and potential project attributes to access the Bureau of Land Management's hydropower site surveys
- Locations and attributes of protected areas as defined by the Northwest Power and Conservation Council.

Canvassing hydropower stakeholders would no doubt lead to the identification of other feature sets that should be made available for display and reference.

Entities controlling large land holdings, such as the U.S. military and Indian tribes, would benefit from customized versions of the assessment studies that have been performed. Such assessments would present subsets of the countrywide information to identify water energy resources and potential projects on the land under their purview. This would assist them in planning and securing funding, and if implemented, would provide energy security while providing electricity for their residents and operations.

The tools and techniques that have been developed for assessing the United States natural stream resources could be applied anywhere in the world. Other developed countries and particularly developing countries would benefit from an assessment of their resources, the identification of promising development sites, and a GIS tool to assist in site evaluation and planning development of water energy resources.

The resource assessment and subsequent feasibility assessment that have been performed were limited to natural stream, potential energy, water energy resources. The United States has other abundant sources of water energy that could be harnessed including:

- Locations on natural streams with little or no elevation difference, but sufficient velocity and depth to accommodate hydrokinetic turbines
- Constructed waterways
- Tidal estuaries
- Ocean currents
- Ocean waves.

Efficient development of these resources would be aided by determining the spatial distribution of their gross power potential, identifying feasible development sites, and estimating the realistic power potential at these sites. All stakeholders and particularly developers would greatly benefit from a GIS application addressing these resources like

the VHP. Such a tool would not only provide information about resources, but would help to ensure that investment is not made in areas where development is unlikely to succeed.

Small hydropower developers would benefit from two information resources: a catalog of small hydropower technologies and a cost estimating guide that would assist them in making preliminary estimates of development costs. A pilot technology catalog (Hall & Dalton 2004) was published, but was not fully developed. A catalog of this type would serve the obvious function of informing developers of equipment available for their project. Because it was envisioned that the catalog would also contain technologies that have

not reached the commercial stage of development, it would have the benefits of exposing promising technologies to additional development and revealing gaps where new technologies are needed. In addition to knowing what technologies are available, developers need to be able to get preliminary estimates of development costs including: licensing, construction, mitigation, and operations and maintenance. A previous study (Hall et al. 2004) provided cost estimating tools for these costs, but was limited to projects having nameplate capacities of 1 MW or greater. A reference that focused on low power and small hydro projects would provide greater applicability to these power classes of hydropower projects.

7. REFERENCES

- Connor, A. M., J. E. Frankfort, and B. N. Rinehart, 1998, *U.S. Hydropower Resource Assessment Final Report*, DOE/ID-10430.2, December 1998.^e
- ENERmap, 2005, U.S. power system GIS data layer purchased from ENERmap, LLC January 2005.
- ESRI, 2004, Environmental Systems Research Institute (ESRI) StreetMap data layer, 2004.
- Federal Energy Regulatory Commission, 1998, *Hydroelectric Power Resources Assessment (HPRA) Database*.
- Hall, D. G., R. T. Hunt, K. S. Reeves, and G. R. Carroll, 2003, *Estimation of Economic Parameters of U.S. Hydropower Resources*, INEEL/EXT-03-00662, June 2003.^e
- Hall, D. G., S. J. Cherry, K. S. Reeves, R. D. Lee, G. R. Carroll, G. L. Sommers, and K. L. Verdin 2004, *Water Energy Resources of the United States with Emphasis on Low Head/Low Power Resources*, DOE/ID-11111, April 2004.
- Hall, D. G. and J. L. Dalton, 2004, *Catalog of Low Power Hydropower Technologies*, DOE/NE-11181, October 2004.
- Verdin, K., and S. Jenson, 1996, "Development of Continental Scale DEMs and Extraction of Hydrographic Features," *Proceedings of the Third International Conference/Workshop on Integrating GIS and Environmental Modeling*, Santa Fe, New Mexico, January 21–26, 1996. (CD-ROM available from National Center for Geographic Information and Analysis, Santa Barbara, California, 93106, USA).
- Vogel, R. M., I. Wilson, and C. Daly, 1999, "Regional Regression Models of Annual Streamflow for the United States," *Journal of Irrigation and Drainage Engineering*, May/June 1999, pp. 148–157.

e. This report is accessible in pdf format on the Internet at:
<http://hydropower.inl.gov/resourceassessment/>

Appendix A
Description of Exclusion Zones

Appendix A

Description of Exclusion Zones

In this study, exclusion zones were areas in which development of new hydroelectric plants is highly unlikely either because of land use designated by federal statutes and policies or because of known environmental sensitivities. These zones were used to apply the feasibility criteria stipulating that a water energy resource site must not be located in an exclusion zone if it is to be designated as a feasible potential project. Geographic information system (GIS) tools were used to determine whether any part of a stream reach corresponding to a water energy resource site intersected the polygon area representing the exclusion zone. If any part of the reach intersected the zone, the site was designated as unfeasible for development. However, if no part of the reach intersected the zone, no matter how close to the zone boundary it is, the exclusion zone feasibility criteria were considered to be met affirmatively. The two sections of this appendix each describe one of the two types of exclusion zones used in the study and the data that was used for analysis.

States, regional jurisdictions, and local jurisdictions have also designated protected areas that are most likely excluded from hydropower development. However, information regarding these protected areas is scattered among numerous state, regional, and local government agencies. Much of this information is not yet in digital format, and much of the digital data are not available online.

Determining the boundaries of lands protected by nonfederal agencies would have entailed contacting a large number of agencies in the country and collecting and digitizing multiple paper datasets in a variety of formats. Such an effort was beyond the scope of the study. It is fortunate that the Conservation Biology Institute provides georeferenced data for environmentally sensitive areas as is discussed in Section A-2.

A-1. Federal Exclusion Zones

Two GIS data layers from the National Atlas of the United States were used to locate federal exclusion zones. The first layer, “Federal and Indian Lands,” contains the boundaries of all federal lands in the United States, subdivided into categories such as national parks, national monuments, Indian reservations, military bases, and DOE sites. The second layer, “Parkways and Scenic Rivers,” contains federally protected linear features such as National Wild and Scenic Rivers and National Parkways. Both GIS data layers are available online from the National Atlas of the United States website at <http://www.nationalatlas.gov/atlasftp.html>.

The categories of federal lands listed in the GIS dataset “Federal and Indian Lands” were reviewed to determine categories corresponding to areas in which hydropower development is highly likely to be excluded. Based on this review, the following categories of federal lands were selected as exclusion zones:

- National battlefields
- National historic parks
- National parks
- National parkways
- National monuments
- National preserves
- National wildlife refuges
- Wildlife management areas
- National wilderness areas.

All the federal lands in these categories were used to create an “excluded federal lands” GIS data layer. Similarly, all national wild and scenic rivers were extracted from the National Wild and Scenic Rivers and National Parkways data

layer to create a GIS data layer composed exclusively of Wild and Scenic Rivers. Because the “wild and scenic rivers data layer” contained only the rivers themselves, but no adjoining land, all land within one kilometer of a wild and scenic river reach was designated as an excluded area. These areas were combined with excluded federal lands to create a final “federal exclusion zone” GIS data layer that contains the boundaries of all lands and shorelines excluded from hydropower development.

A-2. Environmentally Sensitive Exclusion Zones

The Conservation Biology Institute (<http://www.consbio.org/>) provides a GIS data layer containing environmentally sensitive areas designated by four gap analysis program (GAP) categories with GAP-1 being the most restrictive

and GAP-4 being the least restrictive. The definitions of the GAP categories are given in Table A-1.

For the purposes of this study, areas designated with GAP codes 1 and 2 were considered to be exclusion zones in which new hydropower development is highly unlikely. The types of land use areas designated as GAP-1 and GAP-2 are enumerated in Tables A-2 and A-3, respectively. Many of the same types of land use areas appear in both lists, but were apparently discriminated based on the specific use restrictions for each individual area. Many of the exclusion zones based on GAP-1 and GAP-2 areas from the Conservation Biology Institute are coincident with areas that were considered federally designated exclusion zones. No individual area use restrictions were considered for federal exclusion zones.

Table A-1. GAP codes used by the Conservation Biology Institute to designate land use restrictions based on environmental sensitivities.

	GAP Code Description
GAP Code 1	An area having permanent protection from conversion of natural land cover and a mandated management plan in operation to maintain a natural state within which disturbance events (of natural type, frequency, intensity, and legacy) are allowed to proceed without interference or are mimicked through management. Gap Code 1 examples include national parks, wilderness areas, and nature preserves.
GAP Code 2	An area having permanent protection from conversion of natural land cover and a mandated management plan in operation to maintain a primarily natural state, but which may receive uses or management practices that degrade the quality of existing natural communities, including suppression of natural disturbance. Gap Code 2 examples include state and provincial parks, wildlife refuges, and national recreation areas.
GAP Code 3	An area having permanent protection from conversion of natural land cover for the majority of the area, but subject to extractive uses of either a broad, low-intensity type (e.g., logging) or localized intense type (e.g., mining). It also confers protection to federally listed endangered and threatened species throughout the area. Gap Code 3 examples include national forests, wildlife management areas, and Bureau of Land Management lands.
GAP Code 4	There are no known public or private institutional mandates or legally recognized easements or deed restrictions held by the managing entity to prevent conversion of natural habitat types to anthropogenic habitat types. The area generally allows conversion to unnatural land cover throughout.

Table A-2. Types of land use areas designated as GAP Code 1 by the Conservation Biology Institute.

Adaptive Management Area	National Recreation Area	Research Natural Area
Administratively Withdrawn	National Reserve	Scenic Recreation Area
Area of Critical Environmental Concern	National Scenic-Research Area	Scenic Research Area
Botanical Reserve (SIA)	National Volcanic Monument	Special Designation
Congressionally Withdrawn	National Wildlife Refuge	Special Interest Area
Conservation Land	Natural Area	State Park
Ecological Reserve	Nature Conservancy Preserve	State Proposed Research Natural Area
Geologic Area	Nature Preserve	State Scenic Waterway
Late Successional Reserve	Open Water	State Wildlife Reserve
Management Plan Area	OSPRSSW/Deschutes	Tribal Primitive Area
National Forest	Other BLM Land	Tribal Wilderness
National Grassland	Other COE Land	Water
National Historic Park	Other National Park Land	Wild and Scenic Area
National Historical Park	Private Conservation Land	Wild and Scenic River
National Memorial Parkway	Private Institution Managed for Biodiversity	Wilderness
National Monument	Private Land	Wilderness Area
National Outstanding Natural Area	Private Lands	Wilderness Study Area
National Park	Proposed Research Natural Area	Wildlife Habitat Management Area

Table A-3. Types of land use areas designated as GAP Code 2 by the Conservation Biology Institute.

Area of Critical Environmental Concern	Natl River & Wild & Scenic Riverway	Research Natural Area
BLM Holding	Natural Area	Special Designation
BLM/National Wildlife Refuge PW	Natural scenic area	Special Interest Area
BLM/Protective Withdrawal (PW)	Open Water	State Lands
Botanical Area	Other BLM Land	State Lease
Botanical Emphasis Area	Other COE Land	State Memorial
Conservation Easement	Other Federal Land	State Natural Area
Corporate easement	Other Federal Lands	State Park
Ducks Unlimited Managed	Other ODFW Land	State Recreation Area
Fish & Game Access Area	Other USFWS	State RNA
Fish & Game Management Area	Other USFWS Land	State Scenic Waterway
Game Management Area	Park Land	State Wildlife Recreation Area
Game Range	Preservation Easement	TNC Easement
Instant Study Area	Primitive Area	Tribal Wilderness Buffer Zone
Lease	Primitive State Park	USFS/Protective Withdrawal (PW)
Local Land Trust Preserve/Easement	Privately owned, DU managed CE	Water
Military Reservation	Privately owned, Fvlt managed CE	Wayside
National Conservation Area	Privately owned, MLR managed	Wild and Scenic Area
National Forest	Privately owned, MLR managed CE	Wild and Scenic River
National Grassland	Privately owned, MLR managed, PW	Wild River/Wilderness Area
National Monument	Privately owned, TNC managed	Wilderness Area
National Park	Privately owned, TNC managed CE	Wilderness Study Area
National Recreation Area	Privately owned, TNC managed other	Wildlife Area
National Scenic Area	Privately owned, TNC managed regis	Wildlife Habitat Management Area
National Wild & Scenic River	Proposed Natural Area	Wildlife Management Area
National Wildlife Refuge	Proposed Research Natural Area	
Native American Lands	Proposed RNA	